



Sat-Ex 4-20mA Versions

Sat-Ex 20202-0200 4-20mA

Sat-Ex 20202-0205 4-20mA/R

Sat-Ex 20202-0250 4-20mA/C

Sat-Ex 20202-0255 4-20mA/C/R

Table of Contents

Preface	i-i
I. Safety and Warning Notices	i-i
II. General Terms of Use	ii-i
- Conventional Usage	
- Maintenance and Service	
- Use in Areas Subject to Explosion Hazards	
- Liability	
Section 1 Basic Operation	page.
1.1 Principle of Operation	1-1
1.2 Operating States	1-1
1.2.1 Monitoring Mode	1-1
1.2.2 Maintenance Mode	1-2
1.2.3 Warning Condition	1-2
1.2.4 Diagnostics	1-3
1.3 Menu structure	1-3
1.3.1 Maintenance Menu	1-3
1.3.2 Calibration Menu	1-3
1.3.3 Configuration Menu	1-3
1.4 Operational Elements	1-4
1.4.1 Keypad Functions	1-4
1.4.2 Graphic Display	1-4
1.5 Technical Specifications	1-5
Section 2 Installation and Start-up	
2.1 General Guidelines	2-1
2.2 Installation Instructions	2-1
2.3 Mounting the Instrument	2-2
2.3.1 Mounting Instruments with Sensor Extension	2-3
2.3.2 Mounting Sensor Extensions to Exhaust Ducts	2-4
2.4 Electric Wiring	2-5
2.4.1 Wiring Sat-Ex 4-20 mA and 4-20 mA/C	2-5
2.4.2 Wiring Sat-Ex 4-20 mA/R and 4-20 mA/C/R	2-6
2.5 Start-Up	2-9
2.6 Installing the Sensor	2-10
2.6.1 Instruments without Sensor Extension	2-10
2.6.2 Instruments with Sensor Extension	2-10
Section 3 Main Menu	
3.1 The Main Menu Screens	3-1
3.2 Main Menu - Monitoring	3-2
3.3 Main Menu - Maintenance	3-3
3.4 Main Menu - Calibration	3-4
3.5 Main Menu - Configuration	3-5
Section 4 Maintenance	
4.1 Sensor Service	4-2
4.2 Device Information	4-3
4.3 Sensor Information	4-4
4.4 Reset Device	4-6
4.5 Service	4-6

Section 5	Calibration	
5.1	Gas Calibration	5-2
5.1.1	Zero Adjust	5-2
5.1.2	Span Adjust	5-3
5.2	Manual K-Factor	5-4
5.3	Current Output	5-5
5.3.1	Set 0 mA	5-5
5.3.2	Set 4 mA	5-5
5.3.3	Set 20 mA	5-5
Section 6	Configuration	
6.1	Alarm Settings	6-1
6.1.1	Alarm 1	6-3
6.1.1.1	Alarm 1 State	6-4
6.1.1.2	Alarm 1 Level	6-4
6.1.1.3	Alarm 1 Trigger	6-4
6.1.1.4	Alarm 1 Latch	6-4
6.1.2	Alarm 2	6-7
6.2	Language	6-8
6.3	Date Format	6-8
6.4	Auto Selftest	6-9
6.5	Security	6-9
6.6	Password	6-10
6.7	Location	6-10
6.8	New Sensor Type	6-11
6.9	Gas Name	6-11
6.10	Maintenance Signal	6-12
6.11	Warning Signal	6-12
6.12	4-20 mA Range	6-13
6.13	Relays - only for instruments with relay option	6-13
6.13.1	Relay State	6-14
6.13.2	Alarm Delay	6-16
6.13.3	Fault Trigger	6-16
Section 7	Troubleshooting	
7.1	Warning and Fault Messages	7-1
7.1.1	Warnings	7-1
7.1.2	Faults	7-2
Section 8	Reference Information	
8.1	Sensor Order Information	8-1
8.1.1	Sensors for Toxic and Corrosive Gases	8-1
8.1.2	Sensors for Oxygen	8-2
8.1.3	Sensors for Combustible Gases	8-2
8.2	4-20 mA Signal Output Range	8-2
8.3	K-Factors for Sat-Ex C-Versions	8-4
8.4	Spares and Accessories	8-5
8.5	EC-Type Examination Certificate	8-6
8.5.1	EC-Type Examination Certificate - 1st Supplement	8-7
8.5.2	EC-Type Examination Certificate - 2nd Supplement	8-8

Preface

This guide to operation describes the instrument in detail. For proper operation and optimum exposure protection, please read it thoroughly prior to installation and start-up of the instrument and strictly observe all instructions included.

I. Safety and Warning Notices

The Sat-Ex is tested and certified to comply with the requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres. Use of the instrument must be in accordance with the conditions specified in the examination certificate. The instrument must not be used in areas with explosive gas atmospheres (zone 0).

Installation and wiring must be performed by qualified and authorized personnel strictly observing the regulations for equipment used in potentially explosive atmospheres as well as the special conditions of use stated in the instrument's examination certificate.

The installation must also comply with any local electrical and fire codes.

For connection of the Sat-Ex to external control and alarm systems, it is compulsory to use self-contained junction boxes meeting protection class "Ex e".

These junction boxes must be closed prior to start-up of the system and may subsequently only be opened in compliance with the directives for potentially explosive atmospheres.

Do not apply power until the complete system is ready for start-up.

It is not permitted to make any modifications to the instrument or instrument components or to use faulty or incomplete parts.

Use only sensors designed and certified for Sat-Ex instruments.

Never install sensors that were used before in instruments other than Sat-Ex.

Sat-Ex instruments must never be opened while energized.

! Non-observance of any directive results in immediate cancellation of the instrument's registration.

II. General Terms of Use

Conventional Usage

The Sat-Ex is designed for continuous monitoring of TLV or LEL levels of hazardous gas concentrations in ambient air and may only be used for the purpose described in this guide to operation.

Maintenance and Service

According to the regulations the equipment must be inspected and serviced at regular intervals to ensure proper operation. All service procedures must be performed by qualified personnel and must be recorded for verification. We recommend to have your service personnel trained at Honeywell Analytics or to conclude an Honeywell Analytics service contract.

Inspections are to examine the actual condition, maintenance includes measures to maintain the specified condition, and repairs are measures to restore the specified condition. Repairs may only be carried out by trained and qualified personnel. Inspections, service, and repairs are measures to maintain the specified condition.

For inspections, maintenance, and repairs only original Honeywell Analytics spares, consumables and accessories approved for intrinsic safe operation of the instrument may be used. Refer to section 8 for order information on spares, consumables, and accessories.

Use in Areas Subject to Explosion Hazards

The Sat-Ex is tested and certified to comply with the requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres. Use of the instrument must be in accordance with the conditions specified in the examination certificate. The instrument must not be used in areas with explosive gas atmospheres (zone 0).

It is prohibited to modify the instrument or instrument components or to use faulty or incomplete parts. When repairing the instrument or its components make sure to strictly observe all regulations for equipment intended for use in potentially explosive atmospheres as well as the special conditions of use stated in the instrument's examination certificate. Non-observance of any directive results in immediate cancellation of the instrument's registration.

Liability

If the instrument is repaired by personnel not authorized by or employed with Honeywell Analytics or if the instrument is used in a manner not conforming to its intended use, the liability for its proper function is irrevocably transferred to the owner or user.

Honeywell Analytics is not liable for damage resulting from improper installation, misuse, abuse, neglect or accident. Honeywell Analytics is not liable for damage caused by non-compliance with the notices given above.

Above notices do not extend or modify Honeywell Analytics warranty and liability provisions stated in their General Terms and Conditions of Sale.

For further information, please contact your local Honeywell Analytics representative.

This section provides basic understanding of the instrument and its operation.

1.1 Principle of Operation

The Sat-Ex is a gas monitoring instrument especially designed and certified for use in areas with potentially explosive atmospheres. The instrument is designed to interface with standard (0) 4 ... 20 mA alarm or control systems.

Target gas and measuring range depend on the type of sensor chosen. The sensor comes with the specific data in its internal data memory. When a new sensor is inserted, this data is loaded into the instrument's internal memory.

Sat-Ex versions 4-20 mA and 4-20 mA/R use electrochemical sensors for the surveillance of toxic and corrosive gases at TLV levels (TLV = Threshold Limit Value). The sensor output signal is amplified electronically, digitised and the resulting concentration value is transmitted to the communication network.

Sat-Ex versions 4-20 mA/C and 4-20 mA/C/R are used for monitoring combustible gases and vapours. These instruments use catalytic sensors and are factory calibrated for the detection of methane in air mixtures with concentrations up to 5 %-vol. (100 % LEL Lower Explosion Limit). The sensor output signal is amplified electronically, digitised and the resulting concentration value is transmitted to the communication network. To allow the surveillance of a variety of other combustible gases, a specific correction factor called "K-factor" must be entered.

Sat-Ex versions 4-20mA/R and 4-20mA/C/R include the relay option and provide 3 single-pole singlethrow relays for activation of external alarm devices. When the actual gas concentration exceeds the alarm levels, the instrument will activate the appropriate alarm relay and display an according message. A relay will also be activated in case of an instrument fault.

1.2 Operating States

There are four different operating states for the Sat-Ex, Monitoring Mode, Maintenance Mode, Warning Condition, and Diagnostics. Depending on the selected operating state, the green status LED is either on, off, or flashing.

1.2.1 Monitoring Mode

The Monitoring Mode is the instrument's standard operating mode. In the Monitoring Mode, the instrument continuously monitors for hazardous gas concentrations and checks for alarm levels and instrument faults.

The instrument's self-diagnostics provide on-line preventive maintenance information identifying electronics or sensor problems. For example a sensor selftest is performed every 24 hours. The sensor selftest is not available with instruments using oxygen sensors and catalytic sensors. The green LED located above the <set> key is on.

1.2.1.1 Alarm Level Settings

The settings for Alarm Level 1 and Alarm Level 2 are automatically loaded when installing the sensor. Standard settings are 1x and 2x TLV or 20 and 40 % LEL for the target gas. The Alarm Setup function in the Configuration Menu allows the user to change the alarm levels according to their specific requirements.

Whenever the concentration of the target gas exceeds the factory or user programmed alarm levels, the instrument will document this concentration alarm condition on its LCD display.

Instruments with relay option will additionally trigger the associated alarm relays.

1.2.1.2 Reset Alarms Function

Ex factory, Alarm 1 and Alarm 2 are preprogrammed "enabled" and "latching". In the event of a concentration alarm, the alarm indication with latching alarms will continue until the alarm is manually acknowledged by actuating the <set> key. If the password protection is enabled, the password must be entered (see Configuration Menu / Security Function).

Alarm Reset is not possible, if the alarm condition is still present.

1.2.1.3 Exiting the Monitoring Mode

Exiting the Monitoring Mode and entering the Maintenance Mode may be password protected. To prevent the instrument from manipulations by unauthorized personnel, it is recommended to enable this function (see Configuration Menu / Security Function).

- Password enabled:

Actuate the <esc> key to exit the Monitoring Mode and enter the password. The screen to enter the password is shown for one minute. During this period the Monitoring Mode remains active in the background. When the correct password has been entered, the instrument is in the Maintenance Mode, it is not monitoring, and the green LED is off.

- Password disabled:

Actuate the <esc> key to exit the Monitoring Mode. The instrument is now in the Maintenance Mode, the instrument is not monitoring, and the green LED is off.

1.2.2 Maintenance Mode

The Maintenance Mode indicates a complete absence of monitoring capability. The green status LED is off. A maintenance output signal is transmitted to external control systems. This maintenance output signal can be configured either steady, i.e. 2.4 mA, or alternating, i.e. 2.4 to 4.0 mA, 1 Hz.

Depending on the configuration, instruments with relay option will additionally activate the fault relay.

1.2.3 Warning Condition

A warning condition indicates that the Sat-Ex requires some attention, but the instrument is still able to monitor and operate as programmed.

The following will occur when the Sat-Ex detects a warning condition:

- the green status LED is flashing
- an alternating signal (2.8 to 4.0 mA, 0.1 Hz) is sent to external control systems; depending on the configuration, this function can be enabled or disabled.
- instruments with relay option will additionally activate the fault relay, depending on the configuration.

1.2.3.1 Reset Warning Condition

Actuate the <set> key to acknowledge and reset a Warning Condition.
Refer to Section 7, Troubleshooting for specific warnings.

1.2.4 Diagnostics

Instrument faults refer to a problem which prevents the Sat-Ex from operating properly and interferes with the ability to monitor or document concentration alarms.

When the instrument has detected an instrument fault, a steady output signal in the range of 0 and 2.0 mA is sent to attached control systems. The green status LED is off. The LCD display is flashing while indicating the specific fault message.

Instruments with relay option will additionally activate the fault relay.

The Sat-Ex lists specific instrument responses to instrument faults. For information on the various fault messages and instructions on how to correct a fault condition, please refer to Section 7, Troubleshooting.

1.3 Menu structure

Besides the Monitoring Mode, there is also menu operation for the Sat-Ex. Menu operation comprises three groups of functions, maintenance, calibration, and configuration. A password (if enabled) must be entered to exit the Monitoring Mode and to obtain access to the Main Menu.

1.3.1 Maintenance Menu

This function covers the realtime service procedures required for a regular maintenance of the instrument (e.g. sensor replacement).

1.3.2 Calibration Menu

Use the calibration function to dynamically calibrate the Sat-Ex with a known concentration of the target gas or manually by entering a new correction K-Factor.

1.3.3 Configuration Menu

Use this function to configure the Sat-Ex and to program instrument and monitoring parameters to suit individual requirements.

! Note:

If the instrument was in the Monitoring Mode when last powered down, it will automatically return to the Monitoring Mode when power is restored.


1.4 Operational Elements

Located behind the glass window of the Sat-Ex is the graphic display, the keypad consisting of six keys, and above the Set Key the green status LED.

The keys are actuated with the bar magnet provided with each instrument.

1.4.1 Keypad Functions

- o Escape Key <esc>
- o Set Key <set>
- o 4 Cursor Keys marked with an arrow, <up>, <down>, <left>, <right>.

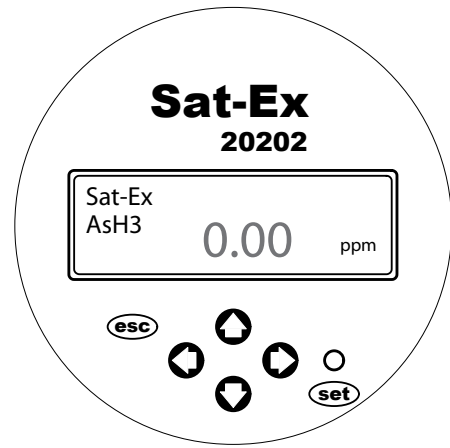


In the Maintenance, Calibration, and Configuration Menu, these keys provide the following functions: To move forwards and backwards in the menus, use the cursor keys <down> and <up>. Select a function by actuating the <set> key.

To enter text or figures, use the cursor keys <left> and <right> to reach the desired cursor position. Use the cursor keys <up> and <down> to select the letter, figure, or sign you wish to enter. Bring the cursor to the next position, select the next letter, figure, or sign. After entering the complete text, use the <set> key to confirm the changes. If you do not want to save the changes, abort by actuating the <esc> key.

1.4.2 Graphic Display


Depending on the operating mode the structure of the graphic display is different. Three basic versions are illustrated and explained below. A detailed description is given in the according sections.

Display Structure for Monitoring Mode

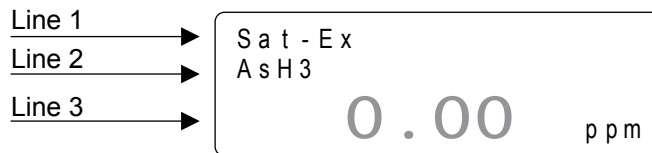

Line 1 offers the possibility to enter a user specific description, e.g. monitoring location (max. 13 spaces; the name of the instrument is entered here when delivered). Line 2 shows the name of the gas monitored. Line 3 indicates the actual gas concentration and the concentration unit. Gas name and concentration unit are data stored in the memory of the sensor installed.

Display Structure for Menu

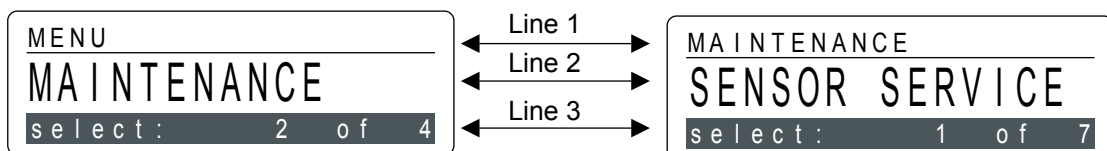


Line 1 shows the actual position in the menu. In the left example the actual position is Main Menu, in the right example it is the submenu Maintenance. Line 2 shows one of the selection possibilities. Line 3 shows the number of the selection possibility presently displayed and indicates also the total of selection possibilities available in this menu.

! Note:

The number of selection possibilities is subject to the instrument version and may be different than indicated in this guide to operation.

1.5 Technical Specifications

Sat-Ex Version	4 - 20 mA	4 - 20 mA/R	4 - 20 mA/C	4 - 20 mA/C/R
Part Number	20202-0200	20202-0205	20202-0250	20202-0255
Sensor Type used				
electrochemical	X	X		
catalytic			X	X
Power Requirements				
voltage	12 ... 24 VDC			
consumption	abt. 1 W	abt. 1.9 W	abt. 1.4 W	abt. 2.4 W
Analog Signal Output				
monitoring mode	4 ... 20 mA			
warning mode	2.8 ... 4 mA, 0.1 Hz			
maintenance mode	2.4 ... 4 mA, 1 Hz			
fault range	0 ... 2 mA			
Connection Cable (cable length of instrument is 2 m / 6 fts)				
4-wire shielded cable 2x2x0,5mm ²	X		X	
10-wire shielded cable 5x2x0,5mm ²		X		X
Relay Outputs contacts 3 x SPST (Single-Pole Single-Throw) max. ratings 250 VAC / 30 VDC, 2A		X		X
Graphic Display	122 x 32 dots with backlight			
Status LED	green			
Keypad	6 control keys			
Tool for Operating Controls	cylindric bar magnet			
Physical Dimensions (including sensor and cable fitting) dimensions (LxWxH)	300 x 143 x 143 mm 11.8" x 5.6" x 5.6"			
weight	3.5 kgs 7.72 lbs			
Mounting	wall mounting			
Protection Class	IP 66			
EMC Directive 2004/108/EC	EN 50270			
Operating Conditions temperature	-20 °C ... +40 °C -4 ... +104 °F			
pressure	800 ... 1100 hPa			
humidity	20 ... 90 % r.h.			
Safety Approvals	 II 2G Ex d [ib] IIC T4 BVS 04 ATEX E 101 X 0158			

This section explains installation and initial start-up procedures.

2.1 General Guidelines

Please consider the aspects indicated below before locating the instrument.

Consider the properties of the target gas (for example lighter or heavier than air etc.) and locate the instrument accordingly. For personal monitoring applications the instrument should be mounted at head level.

The instrument should be mounted as close to the monitoring location as possible and should be easily accessible for operation and maintenance. For narrow monitoring locations or duct mounting a sensor extension is available as an option. Sensor extensions are available with a length of 1, 2 and 3 meters (3, 6, 9 feet).

Ensure that the area immediately surrounding the instrument is free from objects that might hinder free flow of air. The instrument should be installed away from any possible liquid sources, extreme dust and dirt sources and should be protected against rain and sunlight.

Regarding the power requirements and operating conditions, please follow the specifications indicated in section 1, Technical Specifications. Instructions for wiring follow in the course of this section.

Electrochemical sensors which are not in use should be stored in a cool, dry place. This does not apply to catalytic sensors.

2.2 Installation Instructions

Electrical devices with metal housing require an additional external connector for ground wire or equalization of potential. For this purpose the Sat-Ex provides a cable shoe at the exterior of the housing. The minimum conductor cross section of the connected wire must be 4 mm². A lock washer prevents this connection from getting loose or distorted. The far end of the conductor must be connected to the in-plant grounding bar.

As stated in the examination certificate of EXAM the Sat-Ex was tested and approved as electrical apparatus according to Ex d [ib] IIC T4. Installation must be in strict compliance with all conditions specified in the certificate.

This protection class reflects the combination of flameproof housing "d" and intrinsic safety "ib". This means that the Sat-Ex is not a completely intrinsic safe instrument, but includes voltage and current limiting elements to provide intrinsically safe circuits for the sensor to be connected.

Due to these intrinsically safe circuits, maintenance measures as for example sensor exchange can be performed without making it necessary to shut-down the entire system.

For connection of the Sat-Ex to external control and alarm systems it is compulsory to use selfcontained junction boxes meeting protection class "Ex e". These junction boxes must be closed before start-up of the system and may only be opened in compliance with the regulations for hazardous environments since this circuit is not intrinsically safe.

Do not apply power until the complete system is ready for start-up.


2.3 Mounting the Instrument

The housing provides two holes for mounting the instrument. The instrument must be mounted with two screws in a vertical position on a plane and stable surface.

The instrument's connecting cable (A) faces the top, the sensor holder (B) faces the bottom, display and functional elements face the front.

Mount the self-contained junction box meeting protection class "Ex e" at a maximum distance of 2 meters (6 feet) to the instrument.

Connect the instrument to the junction box as shown in the wiring diagram.

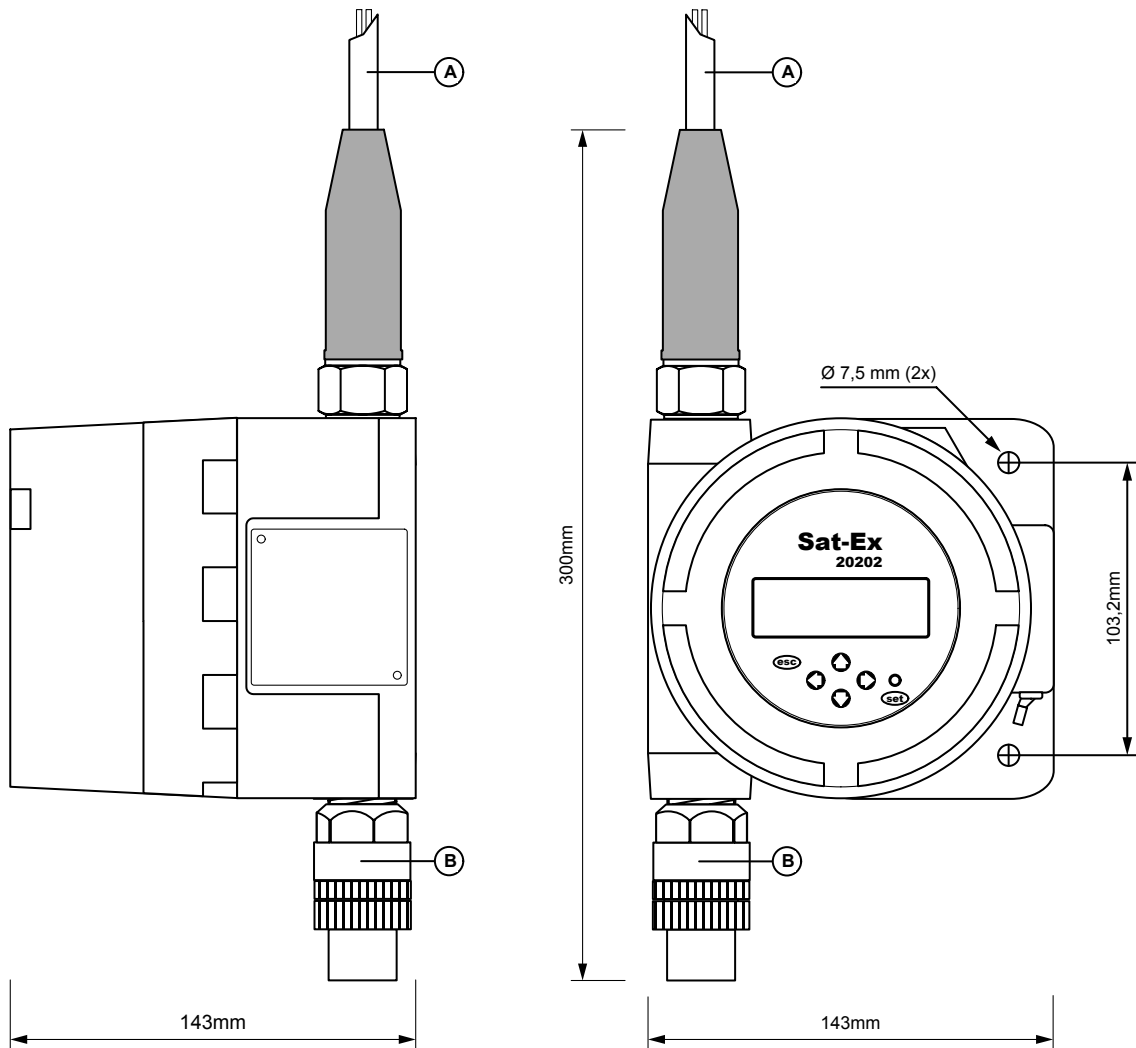

!Note:

For connection of the Sat-Ex to external control systems it is compulsory to use self-contained junction boxes meeting protection class "Ex e".

Junction boxes must be closed prior to start-up of the system and may subsequently only be opened in compliance with the directives for potentially explosive atmospheres.

Do not apply power until the complete system is ready for start-up.

2.3.1 Mounting Instruments with Sensor Extension

Instruments with electrochemical sensors and instruments with catalytic sensors use different sensor extensions which are not interchangeable. Mounting, however, is the same for both types. Accessories and spare parts are listed in section 8.

Mount the instrument on a plane and stable surface as described before.

Now connect sensor extension and instrument:


Connect the connector socket (G) of the sensor extension to the sensor pin connector of the instrument (C), aligning nose of the sensor pin connector and groove (H) of the connector socket.

Screw down sensor extension and sensor plug (C).

C fitting with sensor pin connector of the instrument

G sensor extension with screw joint and connector socket

H positioning aid (groove) on the connector socket

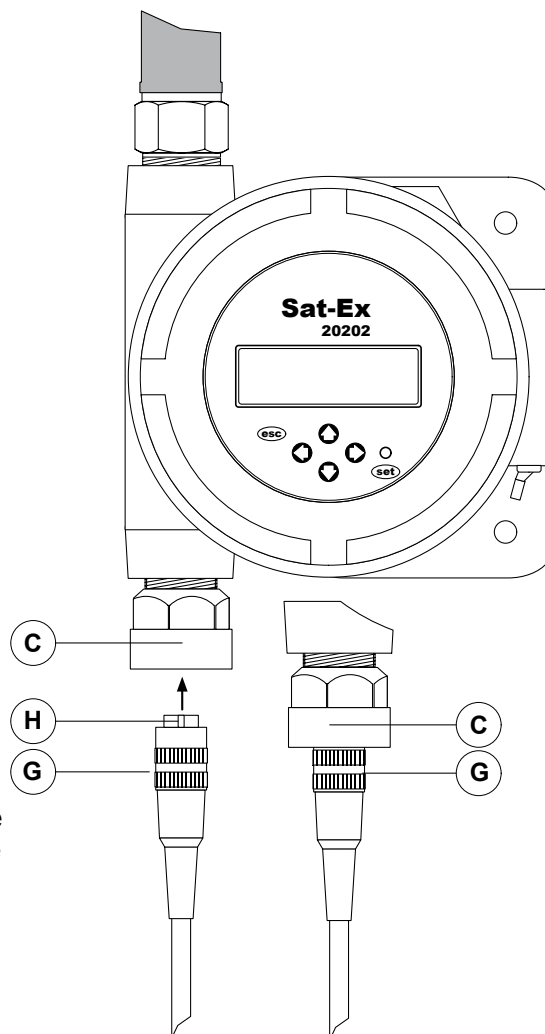

Located at the far end of the sensor extension is the fitting with the sensor pin connector (A).

Connect the sensor (D) to the pin connector (A) of the sensor extension, aligning the positioning aids groove and nose.

Make sure the O-ring (C) is fitted properly before connecting threaded joint (E) and milled nut (B).

A union nut (G) with sealing ring (F) is provided for fastening.

A sensor extension with sensor pin connector

B milled nut


C O-ring

D sensor

E threaded joint

F sealing ring

G union nut

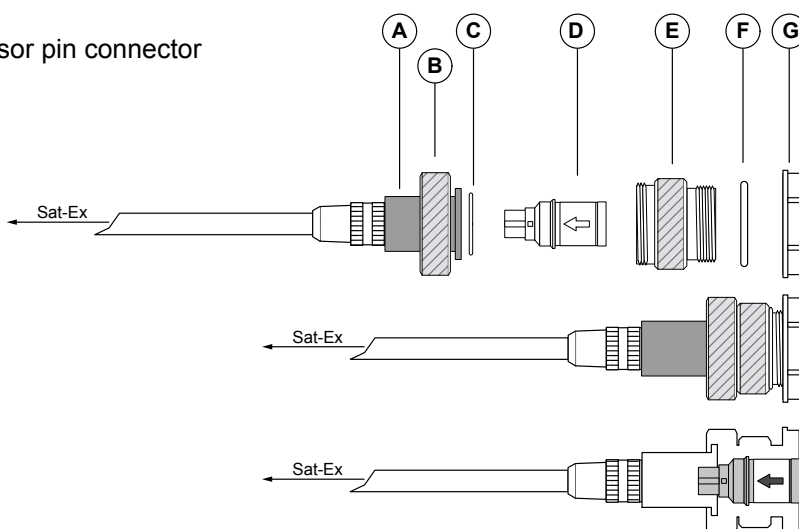

2.3.2 Mounting Sensor Extensions to Exhaust Ducts

For applications with monitoring points located in exhaust ducts, sensor extensions are used in combination with special saddles for duct mounting. These saddles are available in different sizes suitable for many common duct diameters.

Attach the sensor extension to the instrument as described in section 2.2.1.

Prior to mounting the saddle, 3 holes must be drilled into the duct; see figure (K) for details:

- 1 hole (ID 33 mm) for the sensor
- 2 holes (ID 4 mm) for the fastening screws of the saddle (H)

Put the 2 fastening screws through the holes in the saddle (H) and the holes in the silicon seal ring. Fasten the saddle with these screws to the duct. The silicon seal ring must be between duct and saddle.

Screw the threaded joint (E) to the saddle (H).

Connect the sensor (D) to the pin connector of the sensor extension (A), aligning the positioning aids groove and nose.



Make sure the O-ring (C) is fitted properly and screw together milled nut (B) and threaded joint (E).

Now the sensor extension is firmly connected with the saddle.

Unscrew the milled nut (B) to release the connection, for example for a sensor change.

Special blind plugs are available to cover saddles at sample points not in use or obsolete.

To ensure the sensor to work properly, please note that the saddle may only be mounted in one of the positions shown below.

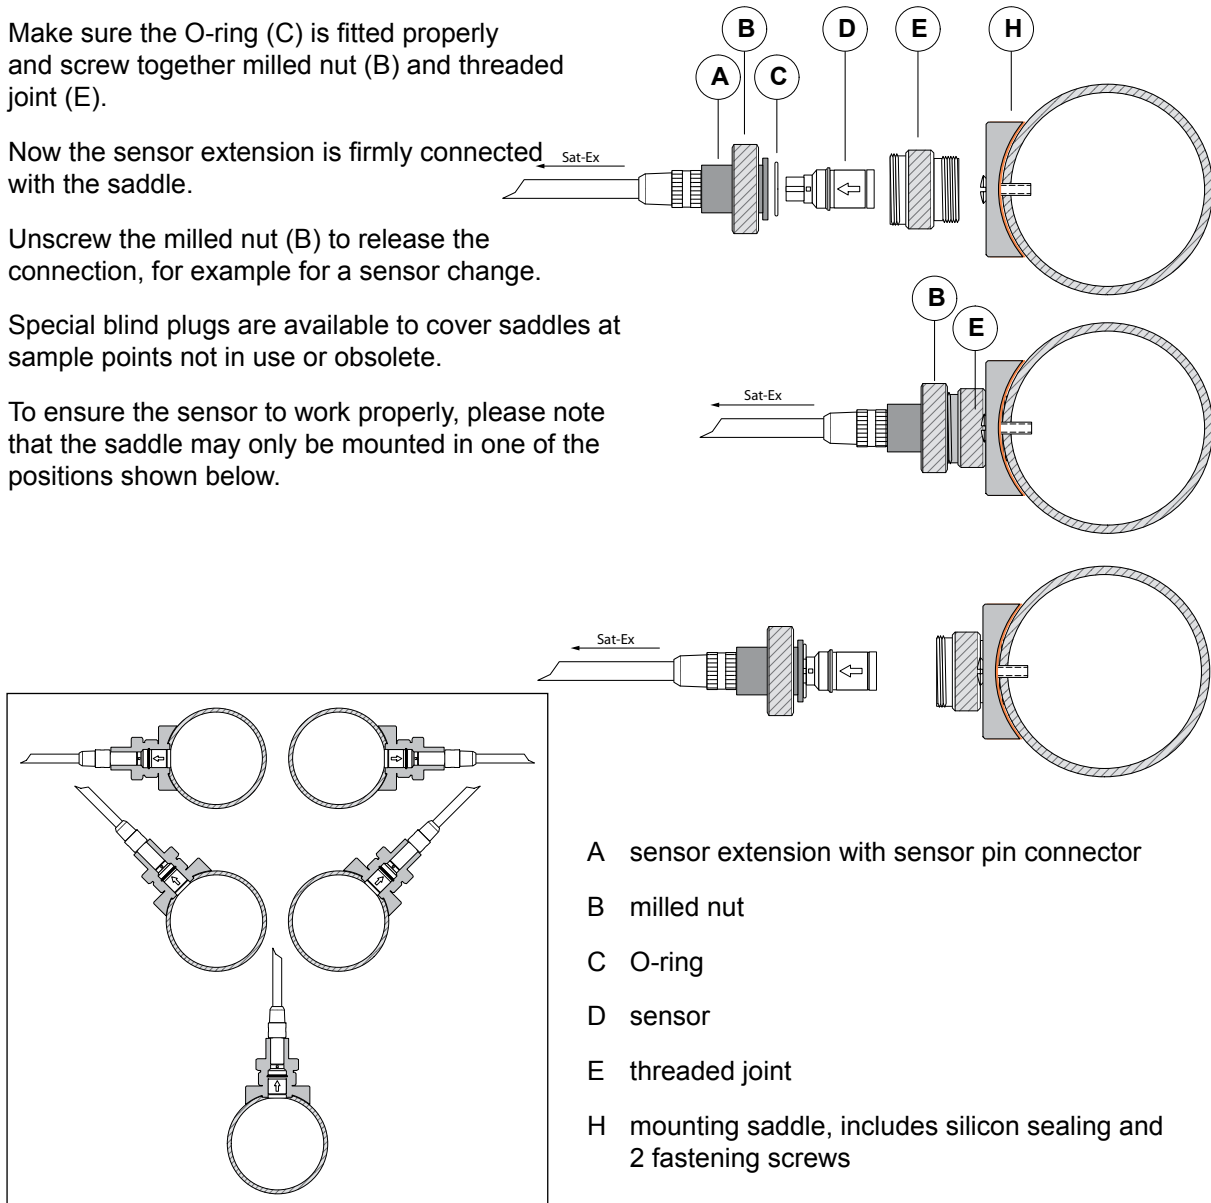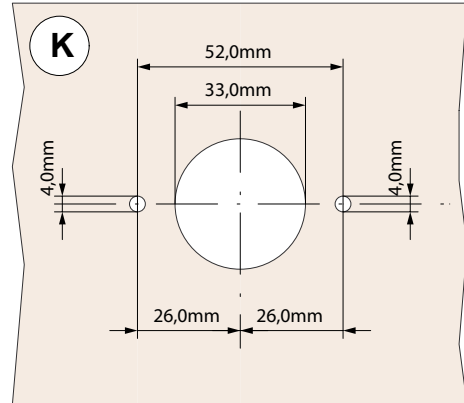

- A sensor extension with sensor pin connector
- B milled nut
- C O-ring
- D sensor
- E threaded joint
- H mounting saddle, includes silicon sealing and 2 fastening screws

2.4 Electric Wiring

Installation and wiring must be performed by qualified and authorized personnel in compliance with any local electrical and fire codes.


Wiring for the Sat-Ex and its related equipment must comply with the regulations on electrical installations in areas subject to explosion hazards and the special conditions of use stated in the instrument's examination certificate. Non-observance of any directive immediately nullifies the instrument's registration.

For connection of the Sat-Ex to external control and alarm systems it is compulsory to use self-contained junction boxes meeting protection class "Ex e". These junction boxes must be closed prior to start-up of the system and may only be opened in compliance with the directives for potentially explosive atmospheres. According to the regulations, cable glands of junction box connections that are not used, must be covered with blind plugs (A), approved for use in hazardous environments.


To interface with external control devices use of a shielded 4-wire cable 2x2x1.0 mm² is recommended.

2.4.1 Wiring Sat-Ex 4-20 mA and 4-20 mA/C

A shielded 4-wire cable of 2 m length is firmly attached to the instrument. Connect the wires at the far end of this cable to the terminals in the junction box as stated in the below table.

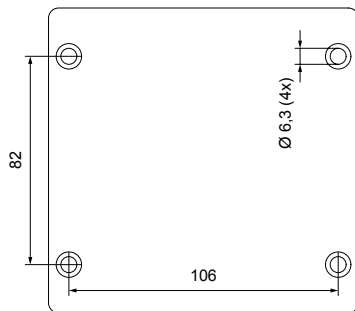

"Ex e" Junction Box Connection			
Sat-Ex 20202 4-20 mA 4-20 mA/C		↔	External Devices (B)
marker	colour		marker
P+	white	12 ... 24 VDC	P+
P-	black	ground	P-
N+	white	4 ... 20 mA	D
N-	black	ground	N-
S		shield	S

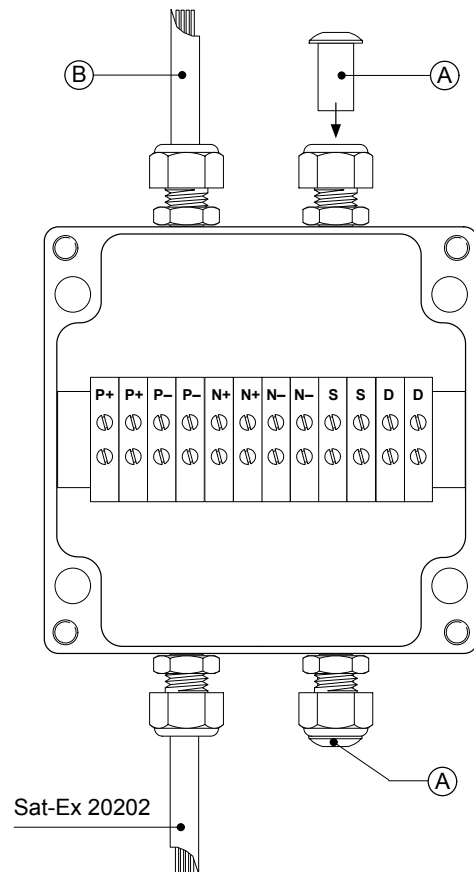


"Ex e" Junction Box - Part No. 20230-0100


According to the regulations cable glands of junction box connections that are not used, must be covered with approved blind plugs (A).

2.4.2 Wiring Sat-Ex 4-20 mA/R and 4-20 mA/C/R

Instruments with relay option are delivered with a shielded 10-wire cable of 2 m length. Connect the wires at the far end of this cable to the terminals in the junction box as stated in the below table.

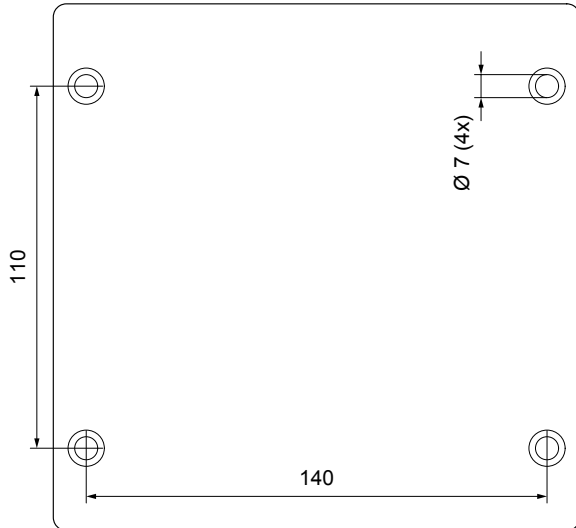

"Ex e" Junction Box Connection			
Sat-Ex 20202 4-20 mA/R 4-20 mA/C/R		↔	External Devices (B) and (C)
marker	colour		marker
P+	white	12 ... 24 VDC	P+
P-	black	ground	P-
N+	white	4 ... 20 mA	D
N-	black	ground	N-
S		shield	S
1	white	alarm 1	A1
1	black	alarm 1	A1
2	white	alarm 2	A2
2	black	alarm 1	A2
3	white	fault	F
3	black	fault	F

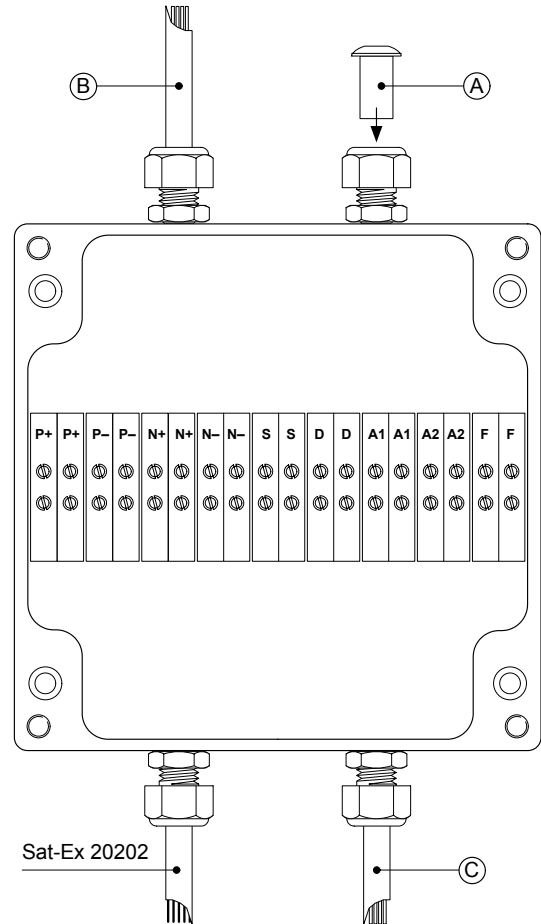


"Ex e" Junction Box - Part No. 20230-0105

For each of the internal relays two contacts are available in the junction box for activation of external alarm devices for visual or acoustic alarm indication.


According to the regulations cable glands of junction box connections that are not used, must be covered with approved blind plugs (A).

! Note:


All wiring for the Sat-Ex and its related equipment must be in compliance with any local electrical and fire codes. The Sat-Ex wiring must be kept away from any high power lines. All shielding for the wiring must be connected together and grounded at only one point in the system.

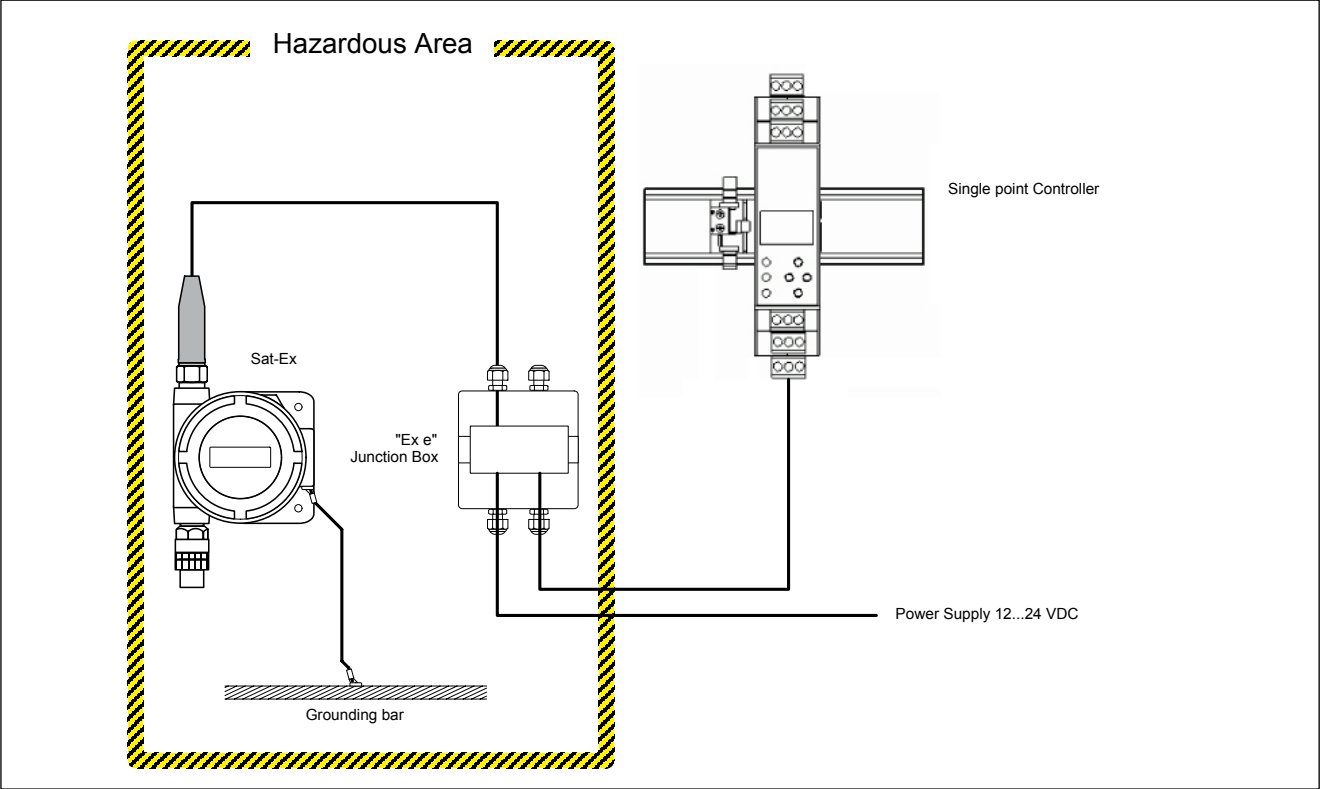

Wiring Diagram Sat-Ex 4-20 mA and Single-point Controller

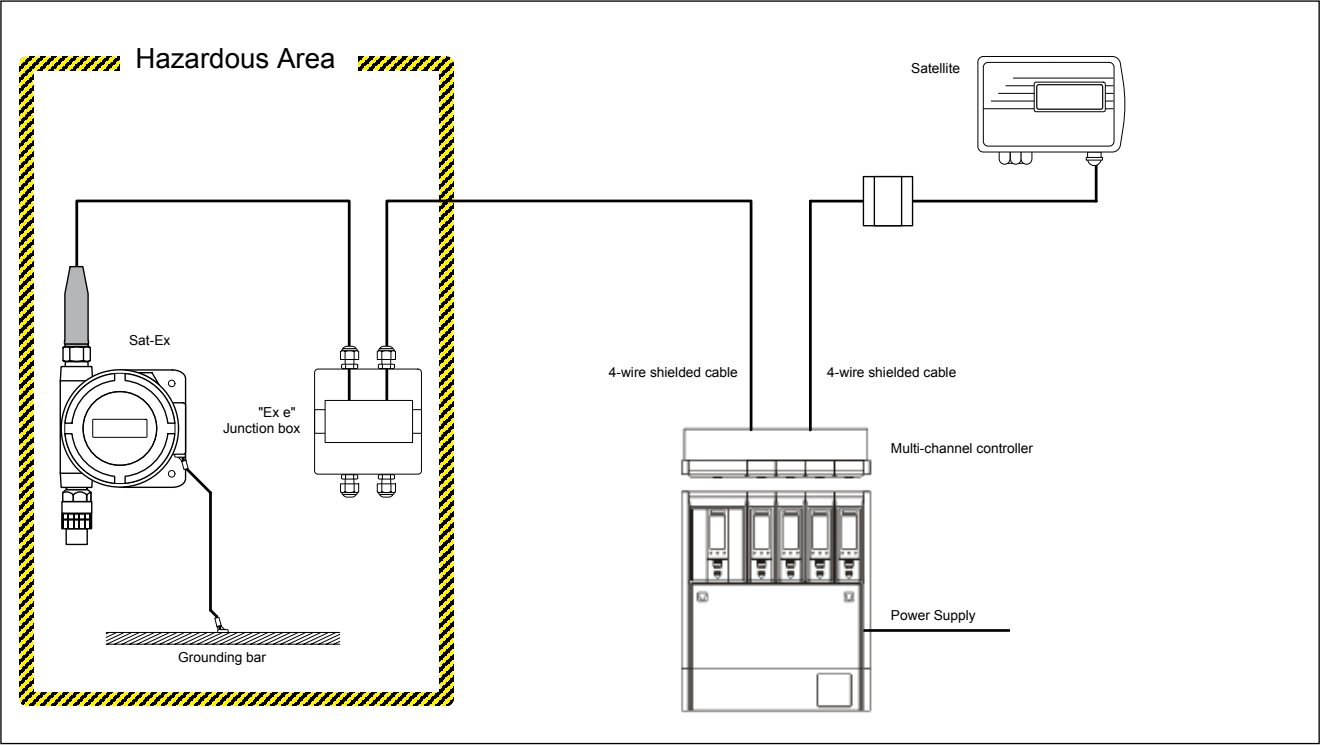

Wiring Diagram Sat-Ex 4-20 mA and Multi-channel Controller

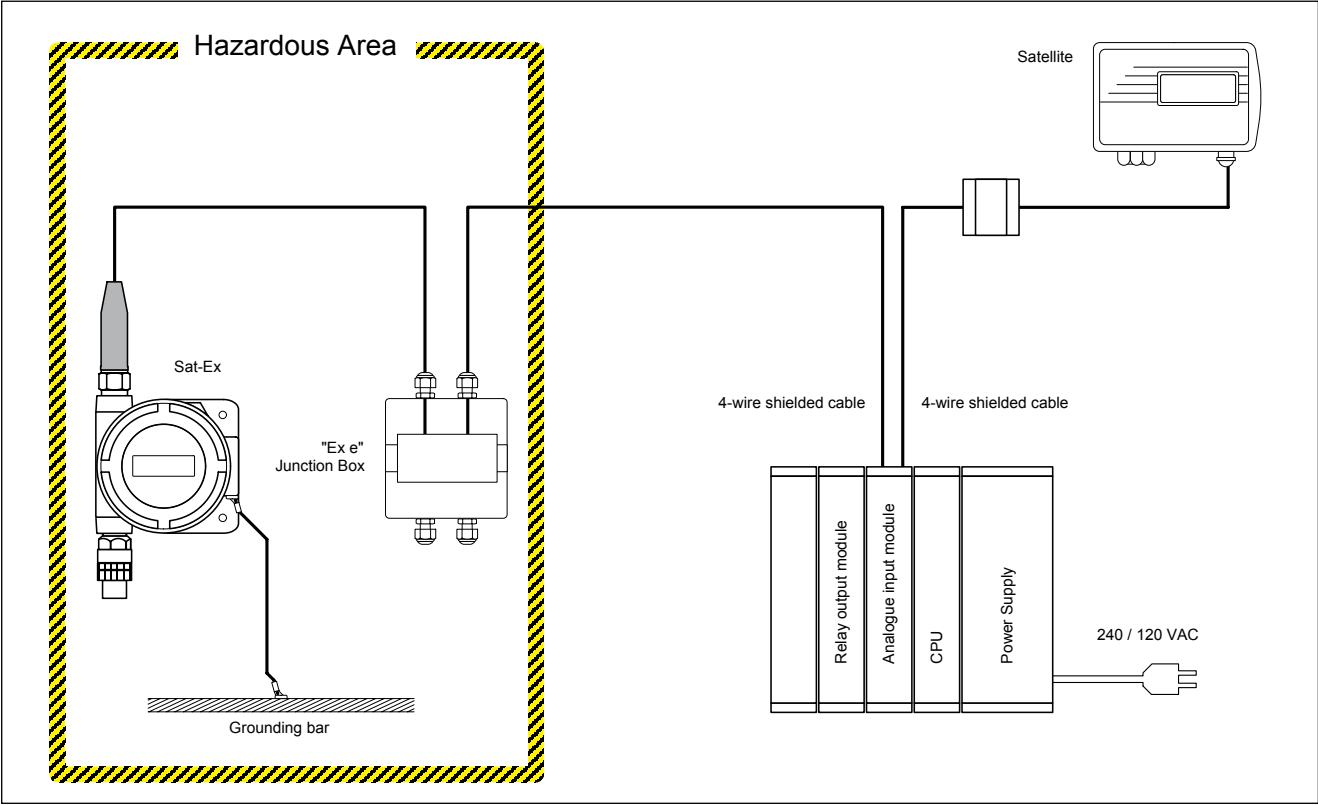

Wiring Diagram Sat-Ex 4-20 mA and PLC

2.5 Start-Up

When installation is completed and the system is ready for start-up, a sensor must be assigned to each instrument. Every sensor was gas calibrated at the factory and these sensor specific calibration parameters are stored in its integrated data memory. Make sure to use only sensors designed and certified for use with Sat-Ex instruments.

Ex factory the instruments are shipped either unconfigured or already preconfigured according to the customer's specifications.

For preconfigured instruments a certain sensor, which can be identified by its serial number printed on the packaging and the sensor label, is assigned and documented to one particular Sat-Ex. These data are stated in the test certificate provided with the shipment.

Switch on the power supply. The instrument performs a sensor warm-up (except with oxygen sensors) and the graphic display shows the below screen until the displayed value is zero. The required warm-up time depends on the type of sensor. The instrument is in the Maintenance Mode and the green LED is off.




SENSOR WARM-UP!
1.23 ppm

The instrument will automatically switch to the Monitoring Mode. The graphic display shows the below screen, the green status LED is on, the instrument is monitoring.



Sat - Ex
AsH3
0.00 ppm

If the instrument displays the message "FAULT - NO SENSOR" when power is supplied, there is no sensor fitted (or a sensor not designed for use with Sat-Ex instruments).

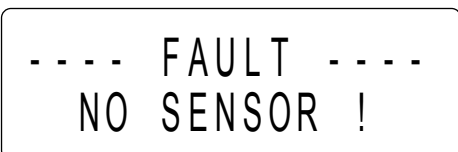

--- FAULT ---
NO SENSOR !

To eliminate this problem, plug in the assigned sensor as described hereafter in section 2.6.

! Note:

Use only sensor types designed and certified for use with Sat-Ex instruments.

Never install sensors that were used before in instruments other than Sat-Ex.

If the instrument does not perform as described above and a fault message is shown, please refer to section 7, Troubleshooting.

! Instruments with CATALYTIC sensors:

Zero Adjustment must be performed prior to start-up. It is recommended to repeat Zero Adjustment every 4 to 6 weeks. For details refer to Section 5, Calibration.

! Instruments with OXYGEN sensors:

Span Adjustment must be performed prior to start-up. It is recommended to repeat Span Adjustment every 4 to 6 weeks. For details refer to Section 5, Calibration.

2.6 Installing the Sensor

Unpack the assigned sensor. Certain sensor types are shipped with a shorting link to help extend sensor life during storage. This link must be removed prior to installation.

2.6.1 Instruments without Sensor Extension



- Unscrew and remove the cap from the instrument's sensor holder (1).
- Connect the sensor with its connector socket to the pin connector of the instrument, aligning the positioning aids groove and nose (2).
- Put the cap over the sensor and reconnect it to the sensor holder of the instrument (3).
- A sensor warm-up is performed, which may take several minutes. There is no warm-up with oxygen sensors.

As soon as the sensor warm-up is finished, the instrument automatically switches to the Monitoring Mode; see section 2.5 for details.

2.6.2 Instruments with Sensor Extension

- Release the connection of milled nut (B) and threaded joint (E) at the far end of the sensor extension.
- Connect the sensor with its connector socket to the pin connector of the sensor extension, aligning the positioning aids groove and nose.
- Make sure the O-ring (C) is fitted properly and reconnect milled nut (B) and threaded joint (E).
- A sensor warm-up is performed, which may take several minutes. There is no warm-up with oxygen sensors.

As soon as the sensor warm-up is finished, the instrument automatically switches to the Monitoring Mode; see section 2.5 for details.

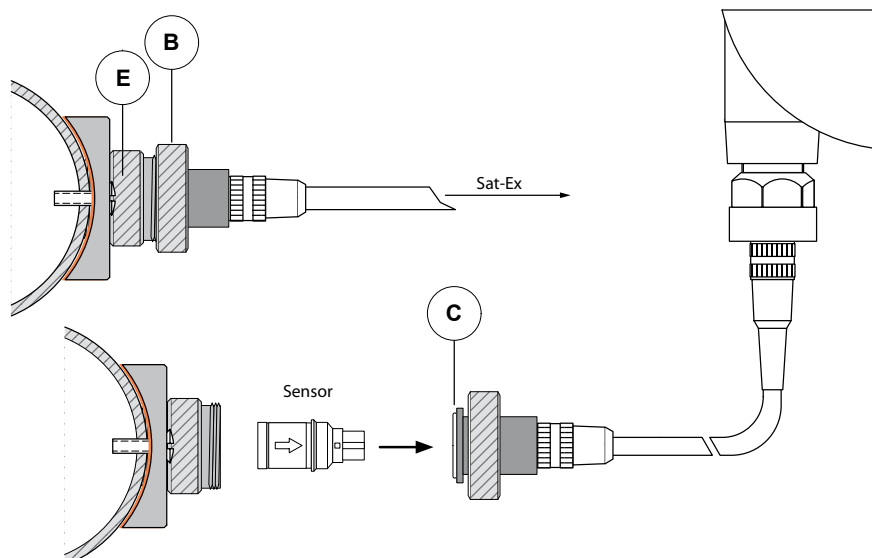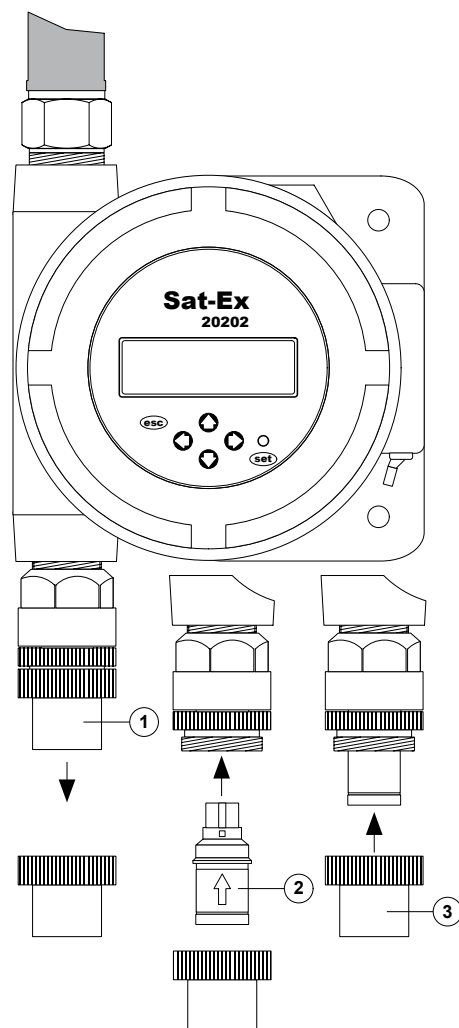


This section explains the different monitoring conditions and the submenus available under the Main Menu.

3.1 The Main Menu Screens

When the <esc> key is actuated, the instrument will leave the Monitoring Mode and go to the Main Menu. The instrument is now in the Maintenance Mode and the green LED is off. Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu. Actuate the <set> key to select a submenu. Actuate the <esc> key to go back to the Main Menu.

To return to the Monitoring Mode, go to the menu 'MONITORING' and actuate <set> to select. The display shows the monitoring screen again and the illuminated green LED indicates, that the instrument is in the Monitoring Mode.

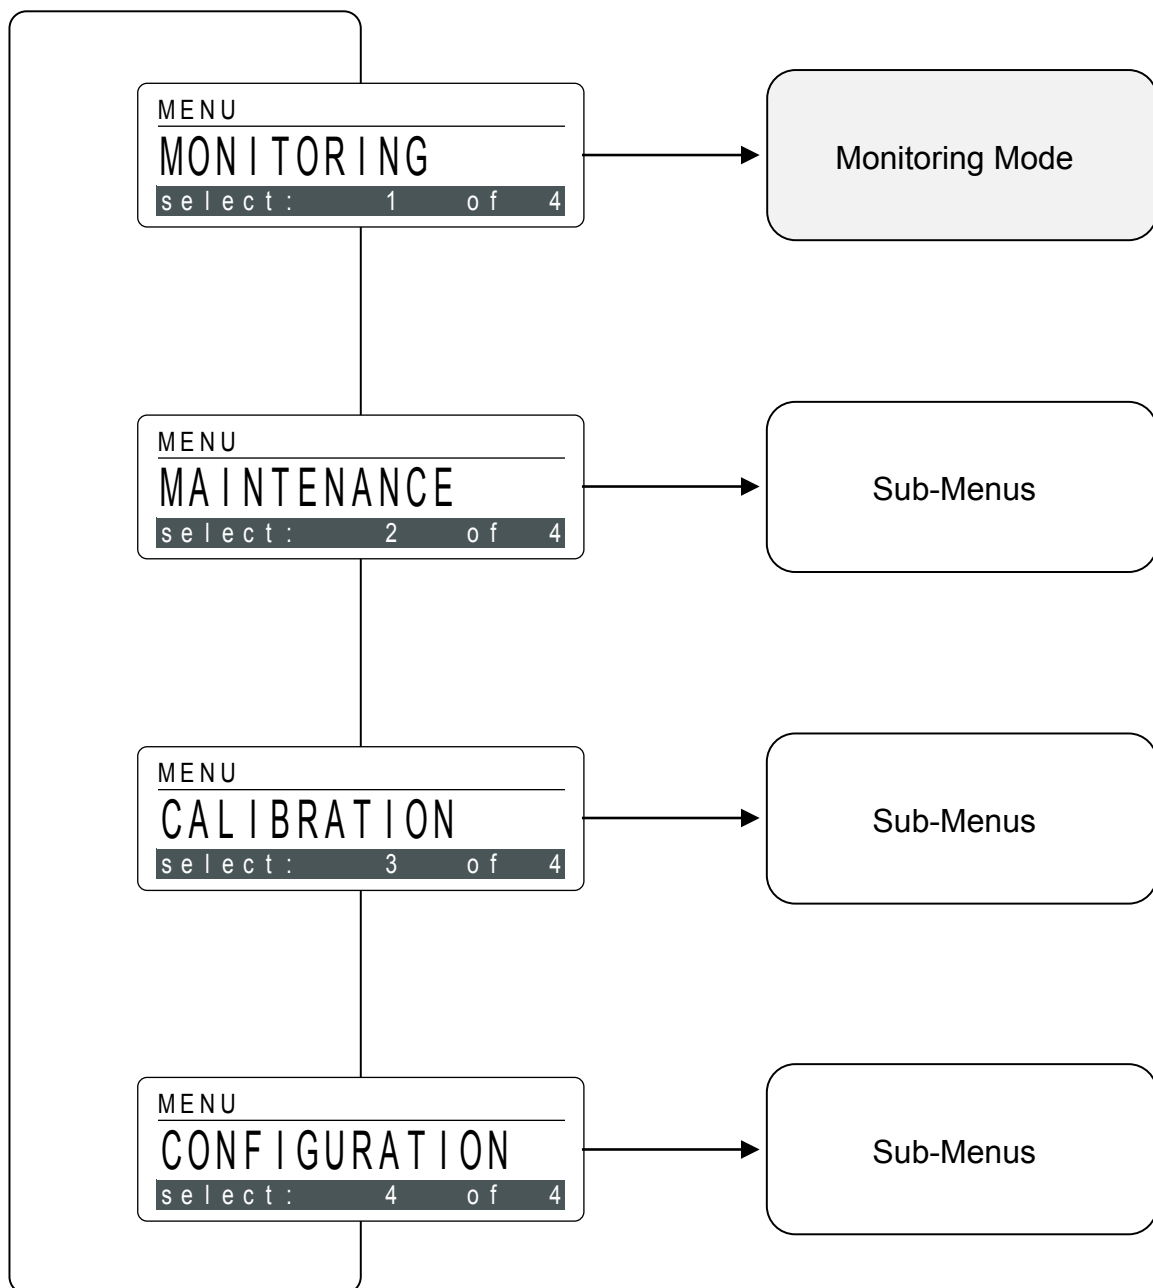

**Main Menu - Monitoring**


The instrument is in the operating mode Maintenance and the green LED is off.

Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu.

Actuate the <set> key to enter the Monitoring Mode.

**<Normal Condition>**

This screen and the illuminated green LED indicate that the instrument is in the Monitoring Mode and is operating properly.

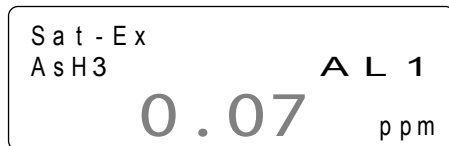**<Alarm 1 Condition>**

This screen shows that Alarm Level 1 has been exceeded and that there is an actual gas concentration of 0.07 ppm AsH3.

(f.i. Alarm 1 set at 0.05 ppm AsH3)

**<Alarm 2 Condition>**

This screen shows that Alarm Level 2 has been exceeded and that there is an actual gas concentration of 0.12 ppm AsH3.

(f.i. Alarm 2 set at 0.10 ppm AsH3)

MENU

MAINTENANCE

select: 2 of 4

MAINTENANCE

SENSOR SERVICE

select: 1 of 5

MAINTENANCE

DEVICE INFOS

select: 2 of 5

MAINTENANCE

SENSOR INFOS

select: 3 of 5

MAINTENANCE

RESET DEVICE

select: 4 of 5

MAINTENANCE

SERVICE

select: 5 of 5

Main Menu - Maintenance

The instrument is in the Maintenance Mode and the green LED is off. Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu.

To select a submenu, actuate the <set> key to enter.

Submenus - Maintenance**Sensor Service**

screen 1 of 5

Device Infos

screen 2 of 5

Sensor Infos

screen 3 of 5

Reset Device

screen 4 of 5

Service

screen 5 of 5

MENU
CALIBRATION
select: 3 of 4

CALIBRATION
GAS CALIBRATION
select: 1 of 3

CALIBRATION
MANUAL K-FACTOR
select: 2 of 3

CALIBRATION
CURRENT OUTPUT
select: 3 of 3

Main Menu - Calibration

The instrument is in the Maintenance Mode and the green LED is off. Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu.

To select a submenu, actuate the <set> key to enter.

Submenus - Calibration**Gas Calibration**

screen 1 of 3

Manual K-Factor

screen 2 of 3

Current Output

screen 3 of 3

MENU

CONFIGURATION

select: 4 of 4

CONFIGURATION

ALARM SETTINGS

select: 1 of 13

CONFIGURATION

LANGUAGE

select: 2 of 13

CONFIGURATION

DATE FORMAT

select: 3 of 13

CONFIGURATION

AUTO SELFTEST

select: 4 of 13

CONFIGURATION

SECURITY

select: 5 of 13

CONFIGURATION

PASSWORD

select: 6 of 13

continued
▼**Main Menu - Configuration**

The instrument is in the Maintenance Mode and the green LED is off.

Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu.

To select a submenu, actuate the <set> key to enter.

Submenus - Configuration**Alarm Settings**

screen 1 of 13

Language

screen 2 of 13

Date Format

screen 3 of 13

Auto Selftest

screen 4 of 13

! This function is not available with instruments using oxygen sensors or catalytic sensors.

Security

screen 5 of 13

Password

screen 6 of 13

Main Menu - Configuration

Submenus - Configuration

continued
▼

CONFIGURATION

LOCATION

select: 7 of 13

Location
screen 7 of 13

CONFIGURATION

NEW SENSOR TYPE

select: 8 of 13

New Sensor Type
screen 8 of 13

CONFIGURATION

GAS NAME

select: 9 of 13

Gas Name
screen 9 of 13

CONFIGURATION

MAINT. SIGNAL

select: 10 of 13

Maintenance Signal
screen 10 of 13

CONFIGURATION

WARNING SIGNAL

select: 11 of 13

Warning Signal
screen 11 of 13

CONFIGURATION

4 - 20 mA RANGE

select: 12 of 13

4-20 mA Range
screen 12 of 13

CONFIGURATION

RELAYS

select: 13 of 13

Relays
screen 13 of 13

! This submenu is only available for instruments with relay option

This section explains routine maintenance procedures including sensor replacement and specific information on sensor and instrument.

MENU

MAINTENANCE

select: 2 of 4

Main Menu - Maintenance

The instrument is in the Maintenance Mode and the green LED is off. Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu.
To select a submenu, actuate the <set> key to enter.

MAINTENANCE

SENSOR SERVICE

select: 1 of 5

Submenus - Maintenance
Sensor Service
screen 1 of 5

MAINTENANCE

DEVICE INFOS

select: 2 of 5

Device Infos
screen 2 of 5

MAINTENANCE

SENSOR INFOS

select: 3 of 5

Sensor Infos
screen 3 of 5

MAINTENANCE

RESET DEVICE

select: 4 of 5

Reset Device
screen 4 of 5

MAINTENANCE

SERVICE

select: 5 of 5

Service
screen 5 of 5

MAINTENANCE
SENSOR SERVICE
 select: 1 of 5

Sensor Service

To perform a sensor replacement with a new sensor, which must have the same part number. See section 8 for sensor information. Use the <set> key to enter and follow the dialogue displayed at the bottom line of the screen. When the instrument has finished the sensor service procedure, it will automatically enter the Monitoring Mode.

SENSOR SERVICE
REMOVE SENSOR
 <set> when ready

Remove Sensor

Remove the sensor presently installed and actuate the <set> key to proceed.

SENSOR SERVICE
REPLACEMENT
 please insert !

Replacement

Insert the new sensor and actuate the <set> key to continue.

SENSOR SERVICE
LOAD NEW DATA ?
 <set> to confirm

Load New Data ?

If you want the data of the new sensor to be loaded, confirm this by actuating the <set> key.

SENSOR SERVICE
LOADING DATA !
 please wait !

Loading Data !

The new data are now loaded from the sensor into the unit's internal memory.

SENSOR WARM-UP !
 1.23 ppm

<Sensor Warm-Up Condition>

A sensor warm-up is performed and this screen is shown until the displayed value is zero, except for oxygen sensors. The warm-up time depends on the type of sensor.

Sat - Ex
 AsH3
 0.00 ppm

<Normal Monitoring Condition>

The instrument will automatically switch to the Monitoring Mode when the sensor service procedure is finished.

Only instruments with catalytic sensors:

If the displayed value is not zero, a zero adjustment must be performed; refer to section 5, Calibration.

! Note:

When a new sensor is installed the K-factor will automatically revert to the default value 1.00. If individual settings are required, they must be entered again; refer to section 5, Calibration. Catalytic sensors are calibrated for methane. When monitoring for other combustible gases, a K-factor must be entered; a list of detectable gases and K-factors is provided in section 8.

```

MAINTENANCE
DEVICE INFOS
select: 2 of 5
    
```

```

DEVICE INFOS
SW: SAX_Xx.Xx
showing: 1 of 2
    
```

```

DEVICE INFOS
ID: 000123456789
showing: 2 of 2
    
```

Device Infos

Used to obtain instrument specific information, i.e. software version, and ID number.

In general these data are required for service purposes.

Actuate the <set> key to select and move with the cursor keys <up> and <down>. Actuate the <esc> key to exit.

<Actual Software Version>

The version of the software presently installed is shown.

<Specific Identification Number>

The instrument's specific identification number (ID) is shown.

MAINTENANCE

SENSOR INFOS

select: 3 of 5

Sensor Infos

Provides specific information about the sensor presently installed, i.e. part number, serial number, date of first calibration, sensitivity, and revision number. These data are stored in the sensor's memory. Actuate the <set> key to select or use the cursor keys <up> and <down> to continue in the menu.

SENSOR INFOS

PART NUMBER

select: 1 of 5

Part Number

Actuate the <set> key to display the part number of the sensor presently installed.

PART NUMBER

9602-6000

<esc> to exit !

<Actual Sensor Part Number>

Use this information to order replacement sensors. Additional order information is provided in section 8, Sensor Order Information. Actuate <esc> to leave.

SENSOR INFOS

SERIAL NUMBER

select: 2 of 5

Serial Number

Actuate the <set> key to display the serial number of the sensor presently installed.

SERIAL NUMBER

31

<esc> to exit !

<Actual Sensor Serial Number>

This information may be required for service purposes. Actuate the <esc> key to leave.

SENSOR INFOS

1st CALIBRATION

select: 3 of 5

First Calibration

Use the <set> key to display the date when the installed sensor was calibrated for the first time.

1st CALIBRATION

29.05.2007

<esc> to exit !

<Date of First Calibration>

This information may be required for service purposes and to check the age of the sensor. Actuate <esc> to leave.

continued

Sensor Infos

continued

SENSOR INFOS
SENSITIVITY
 select: 4 of 5

Sensitivity
 Use the <set> key to display the sensor sensitivity determined during the first calibration.

SENSITIVITY
 123 nA/ppm
 <esc> to exit !

<Actual Sensitivity>
 This information may be required for service purposes. Actuate the <esc> key to leave.

SENSOR INFOS
REVISION NUMBER
 select: 5 of 5

Revision Number
 Use the <set> key to display the revision number of the gas related information stored in the sensor's memory.

REVISION NUMBER
 0
 <esc> to exit !

<Actual Revision Number>
 This information may be required for service purposes. Actuate the <esc> key to leave.

MAINTENANCE

RESET DEVICE

select: 4 of 5

Reset Device

Offers the possibility to perform a "warm start" of the instrument. Actuate the <set> key to select.

RESET DEVICE

ARE YOU SURE ?

<esc> to exit !

Are You Sure ?

This screen is to confirm that a software reset should be performed. Actuate the <set> key to confirm or use the <esc> key to exit.

SENSOR WARM-UP!

1.23 ppm

<Sensor Warm-Up Condition>

A sensor warm-up is performed and this screen is shown until the displayed value is zero, except for oxygen sensors. The warm-up time depends on the type of sensor.

Sat - Ex
AsH3

0.00 ppm

<Normal Monitoring Condition>

The instrument will automatically switch to the Monitoring Mode when the sensor service procedure is completed.

MAINTENANCE

SERVICE

select: 5 of 5

Service

This submenu is used exclusively by trained Service Personnel. The functions are password protected.

SERVICE

PASSWORD: ***

please enter !

This section describes calibration procedures for the Sat-Ex.
Calibration can be performed either automatically by a dynamic gas calibration or manually by entering a calculated correction factor called K-factor. Also included in this section are the electronic calibration procedures for the (0) 4-20 mA analog interface.

MENU
CALIBRATION
select: 3 of 4

Main Menu - Calibration

The instrument is in the Maintenance Mode and the green LED is off. Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu.

To select a submenu, actuate the <set> key to enter.

Submenus - Calibration

Gas Calibration

screen 1 of 3

CALIBRATION
GAS CALIBRATION
select: 1 of 3

Manual K-Factor

screen 2 of 3

CALIBRATION
MANUAL K-FACTOR
select: 2 of 3

Current Output

screen 3 of 3

CALIBRATION
CURRENT OUTPUT
select: 3 of 3

! Note:

If a high degree of accuracy in monitoring is required, monthly calibration with calibration gas of a known concentration is recommended.

When performing a dynamic calibration, a new correction factor (K-factor) is calculated automatically. The actual value can be displayed in the submenu Manual K-Factor.

Use appropriate safety precautions when handling toxic or corrosive gases and properly vent, if possible.

! Instruments with CATALYTIC sensors:

Zero Adjustment must be performed prior to start-up.

It is recommended to repeat Zero Adjustment every 4 to 6 weeks.

Catalytic sensors must be protected from silicone vapours, which may permanently reduce the sensor's sensitivity.

! Instruments with OXYGEN sensors:

Span Adjustment must be performed prior to start-up.

It is recommended to repeat Span Adjustment every 4 to 6 weeks.

CALIBRATION

GAS CALIBRATION

select: 1 of 3

GAS CALIBRATION

ZERO ADJUST

select: 1 of 2

ZERO ADJUST

APPLY AIR !

use clean air !

ZERO ADJUST

0.01 ppm

Value stable ?

ZERO ADJUST

0.00 ppm

Value o.k. ?

ZERO ADJUST

SAVE ?

<set> to confirm

Gas Calibration

The gas calibration submenu is used for dynamic calibration. For zero adjustment use clean or synthetic air free from measuring gas or any other interfering gases. The sensor must be warmed-up before calibration. For span adjustment it is recommended to use test gas of a known concentration at or slightly above TLV for the target gas. **Always keep to the correct sequence, first perform zero adjustment, then Span Adjustment.**

Zero Adjust

Use the <set> key to enter and follow the dialogue displayed.

Zero adjustment applies for all sensors except oxygen sensors.

Apply Air !

Apply clean or synthetic air to the sensor and actuate the <set> key to continue.

<Actual Zero Point>

Allow the zero reading to stabilize. If the reading is already zero, zero adjustment is not necessary. Actuate the <esc> key to exit. If the reading is not zero, actuate the <set> key to re-adjust the zero point and to continue the procedure.

<Re-adjusted Zero Point>

The reading is zero. Actuate the <set> key to proceed.


Save ?

Actuate the <set> key to save the new zero point and store it in the unit's internal memory.

continued

Gas Calibration

continued

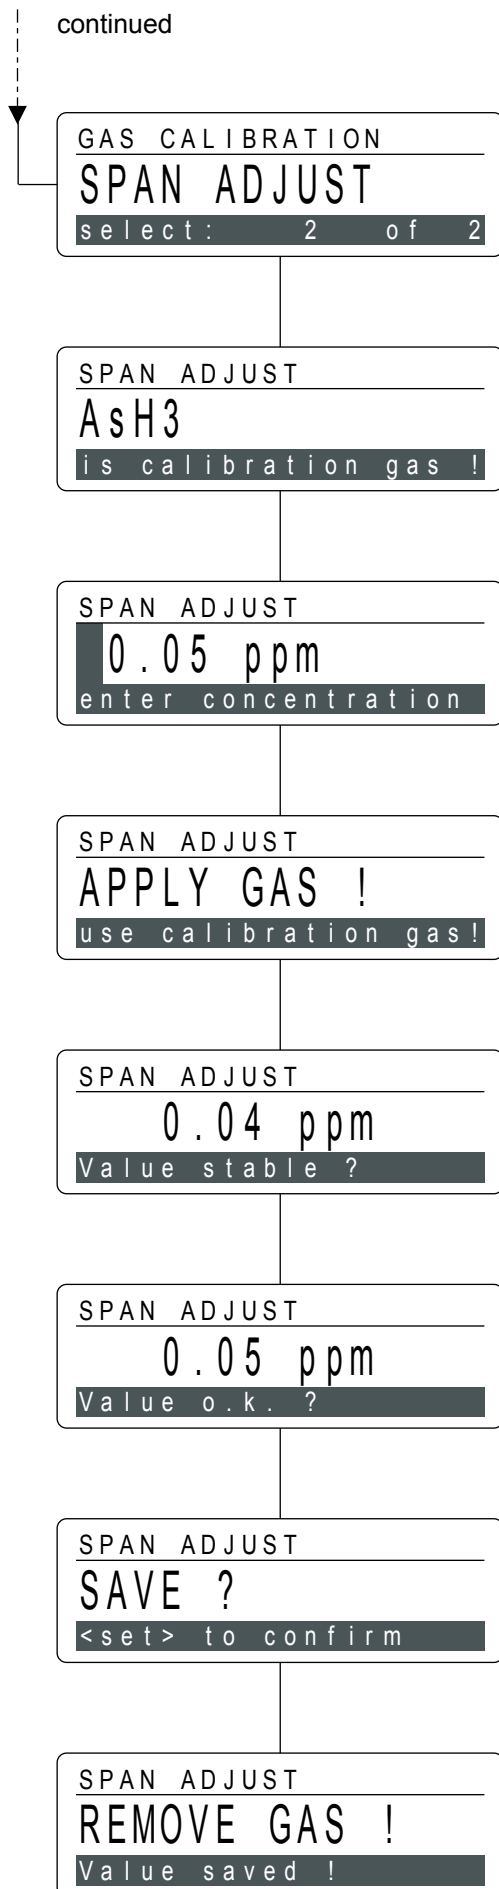**Span Adjust**

Span adjustment applies for all sensors, including oxygen sensors.

Use the <set> key to enter and follow the dialogue displayed.

<Actual Calibration Gas>

The instrument shows which calibration gas is required for the actual sensor type.

<Actual Concentration for Calibration>

The recommended concentration for span adjustment is displayed. Default value is TLV concentration for the target gas. When using calibration gas of a different concentration, change the value accordingly.

After the new value has been entered, actuate the <set> key to continue.

Apply Gas !

Place the calibration cap over the sensor and start the calibration gas flow (18 l/h or 300 ccm/min). Actuate the <set> key to continue.

<Actual Span Value>

Allow the reading to stabilize. If the reading matches the concentration of the calibration gas, span adjustment is not necessary. Actuate the <esc> key to exit.

If the reading does not match the concentration of the calibration gas, actuate the <set> key to re-adjust the span value and to continue the procedure.

<Re-adjusted Span Value>

The reading matches the concentration of the calibration gas. Actuate the <set> key to proceed.

Save ?

Actuate the <set> key to save the new span value and store it in the unit's internal memory.

Remove Gas !

Stop the calibration gas flow. Remove gas and calibration cap.

Allow several minutes for the sensor to clear.

```

CALIBRATION
MANUAL K - FACTOR
select: 2 of 3

```

```

MANUAL K - FACTOR
1.00
please enter !

```

Manual K-Factor

This submenu is used to manually calibrate the instrument by entering a new K-Factor. This factor is a multiplication or correction value used to calibrate the response of the instrument to a specific gas concentration.

The factory default K-Factor for all gases is 1.00. Use the <set> key to enter. The instrument will display the actual KFactor.

<Actual K-Factor>

Use the cursor keys <left> or <right> to reach the desired position. Use the cursor keys <up> and <down> to select the figures you wish to enter. The K-Factor must be in the range of 0.20 and 5.00.

After a new value has been entered, actuate the <set> key to confirm or <esc> to exit.

! Note:

Individual settings for the Manual K-Factor will automatically revert to the default value 1.00, whenever the sensor is replaced by a new sensor.

Only instruments using catalytic sensors:

Catalytic sensors are calibrated for methane. When monitoring for other combustible gases, a K-factor must be entered.

CALIBRATION

CURRENT OUTPUT

select: 3 of 3

CURRENT OUTPUT

SET 0 mA

select: 1 of 3

CURRENT OUTPUT

0 mA set !

<esc> to exit !

CURRENT OUTPUT

SET 4 mA

select: 2 of 3

CURRENT OUTPUT

4 mA set !

<esc> to exit !

CURRENT OUTPUT

SET 20 mA

select: 3 of 3

CURRENT OUTPUT

20 mA set !

<esc> to exit !

Current Output

The 4-20 mA signal output range of the instrument is pre-programmed to correspond to the nominal range of the target gas with 4 mA representing the zero concentration and 20 mA representing the full scale concentration. This submenu provides the possibility to perform functional tests and to scale external control systems. To select a submenu actuate the <set> key to enter or use the cursor keys <up> and <down> to move backwards or forwards.

Set 0 mA

Allows the user to simulate a fault condition. Use the <set> key to enter.

0 mA set !

An analog signal output of 0 mA is now transmitted to external control systems. Use the <esc> key to exit.

Set 4 mA

Allows the user to scale external control systems with an output signal of 4 mA representing the zero concentration value. Use the <set> key to enter.

4 mA set !

An analog signal output of 4 mA is now transmitted to external control systems. Use the <esc> key to exit.

Set 20 mA

Allows the user to scale external control systems with an output signal of 20 mA representing the full scale concentration value. This submenu also serves to simulate alarm conditions. Use the <set> key to enter

20 mA set !

An analog signal output of 20 mA is now transmitted to external control systems. Use the <esc> key to exit.

This section describes the instrument's default configuration and procedures how to adapt it to individual requirements.

MENU

CONFIGURATION

select: 4 of 4

Main Menu - Configuration

The instrument is in the Maintenance Mode and the green LED is off.
Actuate the cursor keys <up> or <down> to move forwards and backwards in the Main Menu.
To select a submenu, actuate the <set> key to enter.

Submenus - Configuration

CONFIGURATION

ALARM SETTINGS

select: 1 of 13

Alarm Settings
screen 1 of 13

CONFIGURATION

LANGUAGE

select: 2 of 13

Language
screen 2 of 13

CONFIGURATION

DATE FORMAT

select: 3 of 13

Date Format
screen 3 of 13

CONFIGURATION

AUTO SELFTEST

select: 4 of 13

Auto Selftest
screen 4 of 13

! This function is not available with instruments using oxygen sensors or catalytic sensors.

CONFIGURATION

SECURITY

select: 5 of 13

Security
screen 5 of 13

CONFIGURATION

PASSWORD

select: 6 of 13

Password
screen 6 of 13

continued

Main Menu - Configuration

Submenus - Configuration

Location

screen 7 of 13

New Sensor Type

screen 8 of 13

Gas Name

screen 9 of 13

Maintenance Signal

screen 10 of 13

Warning Signal

screen 11 of 13

4-20 mA Range

screen 12 of 13

Relays

screen 13 of 13

continued

CONFIGURATION

LOCATION

select: 7 of 13

CONFIGURATION

NEW SENSOR TYPE

select: 8 of 13

CONFIGURATION

GAS NAME

select: 9 of 13

CONFIGURATION

MAINT. SIGNAL

select: 10 of 13

CONFIGURATION

WARNING SIGNAL

select: 11 of 13

CONFIGURATION

4 - 20 mA RANGE

select: 12 of 13

CONFIGURATION

RELAYS

select: 13 of 13

! This submenu is only available for instruments with relay option.

```

CONFIGURATION
ALARM SETTINGS
select: 1 of 13
    
```

Alarm Settings
Allows the user to enter or change various settings for Alarm 1 and Alarm 2 activation. Use the <set> key to enter.

```

ALARM SETTINGS
ALARM 1
select: 1 of 2
    
```

Alarm 1
For Alarm 1 settings, use the <set> key to enter or continue in the menu with the cursor keys <up> or <down>.

```

ALARM SETTINGS
ALARM 2
select: 2 of 2
    
```

Alarm 2
For Alarm 2 settings, use the <set> key to enter or continue in the menu with the cursor keys <up> or <down>.

Alarm 1

Allows the user to configure all parameters for Alarm 1 (lower alarm level) activation.

ALARM SETTINGS

ALARM 1

select: 1 of 2

ALARM 1

ALARM 1 STATE

select: 1 of 4

Alarm 1 State

Used to enable / disable the Alarm 1 activation.

ALARM 1

ALARM 1 LEVEL

select: 2 of 4

Alarm 1 Level

Used to set individual alarm levels for Alarm 1 activation.

ALARM 1

ALARM 1 TRIGGER

select: 3 of 4

Alarm 1 Trigger

Used to define the trigger condition for Alarm 1 activation.

ALARM 1

ALARM 1 LATCH

select: 4 of 4

Alarm 1 Latch

Used to define the Alarm 1 activation to be latching or non-latching.

ALARM 1

ALARM 1 STATE

select: 1 of 4

ALARM 1 STATE

DISABLED

select: 1 of 2

ALARM 1 STATE

ENABLED

select: 2 of 2

Alarm 1 State

Used to enable / disable the Alarm 1 activation. Default setting is enabled. Use the <set> key to enter. The instrument will show the actual setting.

Disabled

Allows the user to turn off the Alarm 1 activation. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

Enabled

Allows the user to turn on the Alarm 1 activation. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

ALARM 1

ALARM 1 LEVEL

select: 2 of 4

ALARM 1 LEVEL

0.05 ppm

please enter !

Alarm 1 Level

Used to set individual alarm levels for Alarm 1 activation. Default setting is 1 x TLV respectively 20 % LEL for the target gas. Actuate the <set> key to enter and show the actual setting.

<Actual Alarm 1 Level>

To change the value, use the cursor keys <left> or <right> to reach the desired position. Use the cursor keys <up> and <down> to select the figures you wish to enter. After the new value has been entered, actuate the <set> key to confirm or <esc> to exit.

ALARM 1

ALARM 1 TRIGGER

select: 3 of 4

ALARM 1 TRIGGER

GREATER THAN

select: 1 of 2

ALARM 1 TRIGGER

LESS THAN

select: 2 of 2

Alarm 1 Trigger

Used to define the trigger condition for Alarm 1 activation. Default setting is Greater Than. Use the <set> key to enter. The instrument will show the actual setting.

Greater Than

Defines that an Alarm 1 condition will be indicated when the actual gas concentration exceeds the pre-set level for Alarm 1. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

Less Than

Defines that an Alarm 1 condition will be indicated when the actual gas concentration falls below the preset level for Alarm 1. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

ALARM 1

ALARM 1 LATCH

select: 4 of 4

ALARM 1 LATCH

DISABLED

select: 1 of 2

ALARM 1 LATCH

ENABLED

select: 2 of 2

Alarm 1 Latch

Used to define the Alarm 1 activation to be either latching or non-latching. Default setting is enabled. Use the <set> key to enter. The instrument will show the actual setting. When latching is enabled, alarm reset must be done manually. Nonlatching alarms will be reset automatically, upon correction of the alarm condition.

Disabled

Defines the Alarm 1 activation to be non-latching. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

Enabled

Defines the Alarm 1 activation to be latching. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

ALARM SETTINGS

ALARM 2

select: 2 of 2

ALARM 2

ALARM 2 STATE

select: 1 of 4

ALARM 2

ALARM 2 LEVEL

select: 2 of 4

ALARM 2

ALARM 2 TRIGGER

select: 3 of 4

ALARM 2

ALARM 2 LATCH

select: 4 of 4

Alarm 2

Allows the user to configure all parameters for Alarm 2 (upper alarm level) activation.

For all subsequent Alarm 2 settings, please follow the procedures described in the corresponding section for Alarm 1 settings.

Alarm 2 State

Used to enable / disable the Alarm 2 activation.

Alarm 2 Level

Used to set individual alarm levels for Alarm 2 activation.

Alarm 2 Trigger

Used to define the trigger condition for Alarm 2 activation.

Alarm 2 Latch

Used to define the Alarm 2 activation to be latching or non-latching.

CONFIGURATION

LANGUAGE

select: 2 of 13

Language

Used to select the desired language for menu operation. Default setting is English.
Use the <set> key to enter. The instrument will display the actual language.

LANGUAGE

GERMAN

select: 1 of 2

German

Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

LANGUAGE

ENGLISH

select: 2 of 2

English

Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION

DATE FORMAT

select: 3 of 13

Date Format

Used to define the format how to display the date (only used in the submenu Sensor Infos, Date of First Calibration). Default setting is International.
Use the <set> key to enter. The actual date format is displayed.

DATE FORMAT

INTERNATIONAL

select: 1 of 2

International

International date format is DD.MM.YYYY
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

DATE FORMAT

USA

select: 2 of 2

USA

USA date format is MM-DD-YYYY
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION

AUTO SELFTEST

select: 4 of 13

AUTO SELFTEST

DISABLED

select: 1 of 2

AUTO SELFTEST

ENABLED

select: 2 of 2

Auto Selftest

The instrument's self-diagnostics provides an on-line preventive sensor selftest performed automatically every 24 hours, which may be enabled or disabled. Default setting is enabled. Use the <set> key to enter. The display will show the actual setting. The function Auto Selftest is not available with instruments using oxygen sensors or catalytic sensors.

Disabled

Allows the user to turn off the Auto Selftest. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

Enabled

Allows the user to turn on the Auto Selftest. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION

SECURITY

select: 5 of 13

SECURITY

PASSWORD ON

select: 1 of 2

SECURITY

PASSWORD OFF

select: 2 of 2

Security

Exiting the Monitoring Mode and entering the Maintenance Mode, may be password protected, to prevent the instrument from manipulations by unauthorized personnel. Ex factory the password protection is disabled. Use the <set> key to enter. The instruments shows the actual setting.

Password On

Allows the user to enable the password protection. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

Password Off

Allows the user to disable the password protection. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION

PASSWORD

select: 6 of 13

PASSWORD

000

please enter !

Password

Allows the user to enter or change the password.
Ex factory the password is <000>.
Use the <set> key to enter. The instrument will display the actual password.

<Actual Password>

To change the password, use the cursor keys <left> or <right> to reach the desired position. Use the cursor keys <up> and <down> to select the figures you wish to enter. After the new password has been entered, actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION

LOCATION

select: 7 of 13

LOCATION

Gas Cabinet

please enter !

Location

Allows the user to enter a description defining the monitoring point. Ex factory it reads <Sat-Ex>. Up to 13 alphanumeric characters can be entered.
Use the <set> key to enter. The instrument will display the actual location.

<Actual Location>

Use the cursor keys <left> or <right> to reach the desired position. Use the cursor keys <up> and <down> to select the characters you wish to enter. When the new location has been entered completely, actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION
NEW SENSOR TYPE
select: 8 of 13

NEW SENSOR TYPE
REMOVE SENSOR
<set> when ready

NEW SENSOR TYPE
NEW SENSOR
please insert !

NEW SENSOR TYPE
LOAD NEW DATA ?
<set> to confirm

NEW SENSOR TYPE
LOADING DATA !
please wait !

CONFIGURATION
GAS NAME
select: 9 of 13

GAS NAME
AsH3
please enter !

New Sensor Type

Allows the user to configure the instrument for a new sensor type with a part number, which is different from the one presently used. See Section 8 for Sensor Information. Actuate the <set> key to enter and follow the dialogue displayed.

Remove Sensor

Remove the sensor presently installed and actuate the <set> key to proceed.

New Sensor

Insert the new sensor and actuate the <set> key to proceed.

Load New Data ?

If you want the data of the new sensor to be loaded, confirm this by pressing the <set> key.

Loading Data !

The new data are now loaded from the sensor into the instrument's internal memory.

Gas Name

Allows the user to enter a different gas name than the one stored in the sensor's data memory. Up to 7 alpha-numeric characters can be entered. Use the <set> key to enter. The instrument will display the actual gas name.

<Actual Gas Name>

Use the cursor keys <left> or <right> to reach the desired position. Use the cursor keys <up> and <down> to select the characters you wish to enter. When the new gas name has been entered completely, actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION

MAINT. SIGNAL

select: 10 of 13

MAINT. SIGNAL

ALTERNATING

select: 1 of 2

MAINT. SIGNAL

CONSTANT

select: 2 of 2

Maintenance Signal

The maintenance signal indicates a complete absence of monitoring capability and is transmitted to external control systems. The maintenance output signal can be configured either steady, i.e. 2.4 mA, or alternating, i.e. 2.4 to 4.0 mA, 1 Hz.

Default setting is alternating. Actuate the <set> key to enter. The instrument shows the actual setting.

Alternating

Defines the maintenance output signal to be alternating.

Actuate the cursor keys <up> or <down> to change.

Actuate the <set> key to confirm or <esc> to exit.

Constant

Defines the maintenance output signal to be constant.

Actuate the cursor keys <up> or <down> to change.

Actuate the <set> key to confirm or <esc> to exit.

CONFIGURATION

WARNING SIGNAL

select: 11 of 13

WARNING SIGNAL

DISABLED

select: 1 of 2

WARNING SIGNAL

ENABLED

select: 2 of 2

Warning Signal

The warning signal indicates that the instrument requires some attention, but is still able to monitor. The warning output signal is an alternating signal of 2.8 to 4.0 mA, 0.1 Hz and is transmitted to external control systems. The warning output signal can be configured enabled or disabled. Default setting is enabled. Actuate the <set> key to enter. The instrument shows the actual setting.

Disabled

Allows the user to turn off the warning output signal.

Actuate the cursor keys <up> or <down> to change.

Actuate the <set> key to confirm or <esc> to exit.

Enabled

Allows the user to turn on the warning output signal.

Actuate the cursor keys <up> or <down> to change.

Actuate the <set> key to confirm or <esc> to exit.

```

CONFIGURATION
4 - 20 mA RANGE
select: 12 of 13

```

```

4 - 20 mA RANGE
1.00 ppm = 20mA
please enter !

```

4-20 mA Range

The 4-20 mA signal output range of the instrument is pre-programmed to correspond to the nominal range of the target gas. The 4-20 mA range may be adjusted to individual requirements, but must not exceed the upper and lower values listed in Section 8. Actuate the <set> key to enter and display the actual setting.

<Actual 4-20 mA Range>

To change the value, use the cursor keys <left> or <right> to reach the desired position. Use the cursor keys <up> and <down> to select the figures you wish to enter. After the new value has been entered, actuate the <set> key to confirm or <esc> to exit.

```

CONFIGURATION
RELAYS
select: 13 of 13

```

```

RELAYS
RELAY STATE
select: 1 of 3

```

```

RELAYS
ALARM DELAY
select: 2 of 3

```

```

RELAYS
FAULT TRIGGER
select: 3 of 3

```

Relays

Allows the user to enter or change various settings for the internal relay contacts for Alarm 1, Alarm 2, and Fault. Use the <set> key to enter. This submenu and all subsequent menu items are only available for instruments with relay option.

Relay State

Used to individually define the relays to be either deenergized (normally open contact) or energized (normally closed contact).

Use the <set> key to enter or continue in the menu with the cursor keys <up> or <down>.

Alarm Delay

Used to set a delay for the relay activation in case of concentration alarms.

Use the <set> key to enter or continue in the menu with the cursor keys <up> or <down>.

Fault Trigger

Used to define the trigger conditions for activation of the Fault Relay.

Use the <set> key to enter or continue in the menu with the cursor keys <up> or <down>.

! Note:

Individual settings for alarm levels, gas name, and the 4-20 mA output range, will automatically revert to the factory programmed settings, whenever a new sensor type with a part number different from the part number of the sensor used before is installed.

The menu RELAYS and all subsequent menu items are only available for instruments with relay option.

RELAYS

RELAY STATE

select: 1 of 3

Relay State
Used to individually define the Alarm 1, Alarm 2, and Fault Relay to be either deenergized (normally open contact) or energized (normally closed contact). Ex factory the relays are deenergized (normally open contacts).
Use the <set> key to enter.

RELAY STATE

ALARM 1 RELAY

select: 1 of 3

Alarm 1 Relay
Allows to set the Alarm 1 Relay state.

RELAY STATE

ALARM 2 RELAY

select: 2 of 3

Alarm 2 Relay
Allows to set the Alarm 2 Relay state.

RELAY STATE

FAULT RELAY

select: 3 of 3

Fault Relay
Allows to set the Fault Relay state.

RELAY STATE

ALARM 1 RELAY

select: 1 of 3

Alarm 1 Relay
Allows the user to set the Alarm 1 Relay state.
Use the <set> key to enter.
The instrument will show the actual setting.

ALARM 1 RELAY

DEENERGIZED / NO

select: 1 of 2

Deenergized / NO
Defines the Alarm 1 Relay to be deenergized (normally open contact).
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

ALARM 1 RELAY

ENERGIZED / NC

select: 2 of 2

Energized / NC
Defines the Alarm 1 Relay to be energized (normally closed contact).
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

RELAY STATE

ALARM 2 RELAY

select: 2 of 3

Alarm 2 Relay

Allows the user to set the Alarm 2 Relay state.
Use the <set> key to enter.
The instrument will show the actual setting.

ALARM 2 RELAY

DEENERGIZED/NO

select: 1 of 2

Deenergized / NO

Defines the Alarm 2 Relay to be deenergized (normally open contact).
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

ALARM 2 RELAY

ENERGIZED/NC

select: 2 of 2

Energized / NC

Defines the Alarm 2 Relay to be energized (normally closed contact).
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

RELAY STATE

FAULT RELAY

select: 3 of 3

Fault Relay

Allows the user to set the Fault Relay state.
Use the <set> key to enter.
The instrument will show the actual setting.

FAULT RELAY

DEENERGIZED/NO

select: 1 of 2

Deenergized / NO

Defines the Fault Relay to be deenergized (normally open contact).
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

FAULT RELAY

ENERGIZED/NC

select: 2 of 2

Energized / NC

Defines the Fault Relay to be energized (normally closed contact).
Actuate the cursor keys <up> or <down> to change.
Actuate the <set> key to confirm or <esc> to exit.

RELAYS

ALARM DELAY

select: 2 of 3

ALARM DELAY

3.0 sec.

please enter !

Alarm Delay

Used to define an alarm delay for concentration alarms. Minimum value is 0, maximum setting is 99.9 seconds. Default setting is 3.0 seconds. Actuate the <set> key to enter and show the actual setting.

<Actual Alarm Delay>

To change the value, use the cursor keys <left> or <right> to reach the desired position. Use the cursor keys <up> and <down> to select the figures you wish to enter. After the new value has been entered, actuate the <set> key to confirm or <esc> to exit.

RELAYS

FAULT TRIGGER

select: 3 of 3

FAULT TRIGGER

FAULT ONLY

select: 1 of 4

FAULT TRIGGER

FAULT+WARNING

select: 2 of 4

FAULT TRIGGER

FAULT+MAINT

select: 3 of 4

FAULT TRIGGER

ALL

select: 4 of 4

Fault Trigger

Allows the user to define, which fault conditions will activate the Fault Relay. Ex factory the setting is Fault Only. Use the <set> key to enter. The instrument will show the actual setting.

Fault Only

Used to configure the Fault Relay to be activated in case of a fault condition only. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

Fault + Warning

Used to configure the Fault Relay to be activated in case of a fault or warning condition only. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

Fault + Maintenance

Used to configure the Fault Relay to be activated in case of a fault or maintenance condition only. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

All

Used to configure the Fault Relay to be activated in case of a fault, warning, or maintenance condition. Actuate the cursor keys <up> or <down> to change. Actuate the <set> key to confirm or <esc> to exit.

This section will help to determine the source of a fault or warning condition and will provide a corrective action.

7.1 Warning and Fault Messages

Warning and Fault are two different kinds of messages, which require different attention.

For any message not explained in this section or any other assistance required, please do not hesitate to contact our service department.


7.1.1 Warnings

A warning condition indicates that the instrument requires some attention, but is still able to monitor and operate as programmed.

The following will occur when the instrument detected a warning condition:


- the green status LED is flashing
- an alternating signal (2.8 to 4.0 mA, 0.1 Hz) is sent to external control systems; depending on the configuration, this function can be enabled or disabled.
- the fault relay is activated, relays and their appropriate configuration provided.

Actuate the <set> key to acknowledge and reset a Warning Condition.

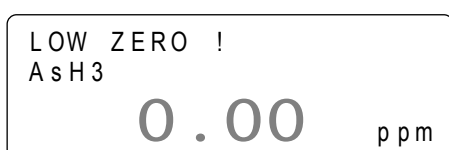

Low Zero !

This message indicates that the zero point of the sensor is out of the optimum range. To correct this problem, check the zero adjustment and recalibrate, if necessary.

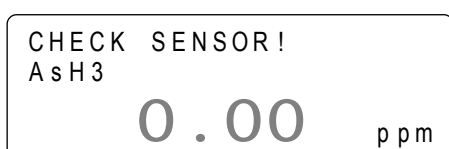

Check Sensor !

This message indicates that the sensor sensitivity does not comply with the specifications. The sensor must soon be replaced.

Whilst most sensors will work for another 2-6 weeks, there are circumstances that may cause an earlier failure of the sensor cell. Honeywell therefore suggests that customers with more critical needs carry out the replacement of the sensor cell within 3 days (72 hours) of receiving the "check sensor" message.

To receive this message, the function Auto Selftest must be configured enabled; refer to Section 6, Configuration.

This function is not available for instruments with oxygen sensor or catalytic sensor.

7.1.2 Faults

Instrument faults refer to a problem which prevents the Sat-Ex from operating properly and interferes with the ability to monitor or document concentration alarms.

When the Sat-Ex has detected an instrument fault, a fault signal of a defined output current for each different fault condition is sent to attached control systems. The green status LED is off. The LCD display is flashing while indicating the specific fault message.

For instruments with relay option the fault relay is activated additionally.

---- FAULT ----
ELECTRONICS !

Fault - Electronics !

This indicates that there is a problem with the internal electronics. The AD Converter has failed. Switch power supply for this unit off and on again. If the instrument still shows this message, switch off power supply for this unit and contact our service department for further instructions.
Output current is 2.0 mA.

---- FAULT ----
NO SENSOR !

Fault - No Sensor !

This message indicates that no sensor or a sensor type not suitable for Sat-Ex instruments is fitted. To eliminate the problem, insert an appropriate sensor. If the Sat-Ex is operated with a sensor extension, this fault message may also be caused by a bad connection. Make sure that all connections are firmly attached.
Output current is 1.8 mA.

---- FAULT ----
WRONG SENSOR !

Fault - Wrong Sensor !

This message indicates that the sensor presently installed is not the sensor assigned to this particular instrument. To correct the problem, insert the sensor assigned and documented to this instrument. The data are stated in the test certificate provided with the shipment.
Output current is 1.6 mA.

---- FAULT ----
REPLACE SENSOR!

Fault - Replace Sensor !

This message indicates that the sensor presently installed is depleted (the warning CHECK SENSOR ! has been ignored). To correct the problem, replace the old sensor immediately.
Output current is 1.4 mA.

This function is not available for instruments with oxygen sensor or catalytic sensor.

8.1 Sensor Order Information (page 1 of 2)

Substance / Sensor		Part No. Sensor	Nominal Range	Unit	Comments
8.1.1 Toxic and Corrosive Gases - not for Sat-Ex C-Versions					
AsH3	Arsine (3 El.)	9602-6004	0 ... 1.00	ppm	
AsH3	Arsine (2 El.)	9602-6000	0 ... 1.00	ppm	special application
AsH3	Arsine (2 El.)	9602-6002	0 ... 10.0	ppm	special application
B2H6	Diborane	9602-6201	0 ... 1.00	ppm	
Br2	Bromine	9602-6800	0 ... 5.00	ppm	
Cl2	Chlorine	9602-5300	0 ... 5.00	ppm	
ClF3	Chlorine Trifluoride	9602-7410	0 ... 1.00	ppm	
ClO2	Chlorine Dioxide	9602-7400	0 ... 1.00	ppm	
CO	Carbon Monoxide	9602-5400	0 ... 500	ppm	
COCl2	Phosgene	9602-6600	0 ... 1.00	ppm	
C2H4O	Ethylene Oxide	9602-8000	0 ... 20.0	ppm	
F2	Fluorine	9602-6400	0 ... 5.00	ppm	
F2	Fluorine	9602-6401	0 ... 30	ppm	
GeH4	Germane	9602-6902	0 ... 5.0	ppm	
H2	Hydrogen (1 %)	9602-5100	0 ... 1.000	% vol.	
H2	Hydrogen (4 %)	9602-5101	0 ... 4.00	% vol.	special range
H2S	Hydrogen Sulfide	9602-5200	0 ... 100	ppm	
H2S	Hydrogen Sulfide (org)	9602-5201	0 ... 30.0	ppm	special application
H2Se	Hydrogen Selenide	9602-5601	0 ... 5.00	ppm	
HBr	Hydrogen Bromide	9602-7000	0 ... 30.0	ppm	
HCl	Hydrogen Chloride	9602-5800	0 ... 30.0	ppm	
HCl	Hydrogen Chloride	9602-5802	0 ... 15.0	ppm	
HCN	Hydrogen Cyanide	9602-5700	0 ... 30.0	ppm	
HF	Hydrogen Fluoride	9602-6500	0 ... 10.0	ppm	
HMDS	Hexamethyldisilazane	9602-6711	0 ... 0.500	% vol.	
HMDS	Hexamethyldisilazane	9602-6712	0 ... 500	ppm	
N2H4	Hydrazine	9602-7600	0 ... 1.00	ppm	
NH3	Ammonia (1000 ppm)	9602-6705	0 ... 1000	ppm	
NH3	Ammonia (100 ppm -H2)	9602-6704	0 ... 100	ppm	
NO	Nitric Oxide	9602-7200	0 ... 250	ppm	
NO2	Nitrogen Dioxide	9602-7300	0 ... 25.0	ppm	
O3	Ozone	9602-7100	0 ... 1.00	ppm	
O3	Ozone	9602-7101	0 ... 1.00	ppm	
PH3	Phosphine (3 El.)	9602-6102	0 ... 1.00	ppm	
PH3	Phosphine (2 El.)	9602-6100	0 ... 1.00	ppm	special application
SiH4	Silane	9602-6301	0 ... 50.0	ppm	
SO2	Sulfur Dioxide	9602-5900	0 ... 25.0	ppm	
TEOS	Tetraethyl Orthosilicate	9602-7500	0 ... 100	ppm	
TMB	Trimethyl borate	9602-7510	0 ... 500	ppm	
TMP	Trimethyl phosphite	9602-7800	0 ... 30.0	ppm	

8.1 Sensor Order Information (page 2 of 2)

Substance / Sensor	Part No. Sensor	Nominal Range	Unit	Comments
8.1.2 Oxygen - not for Sat-Ex C-Versions				
O2 Oxygen	9602-5500	0 ... 25.0	% vol.	

Substance / Sensor	Part No. Sensor	Nominal Range	Unit	Comments
8.1.3 Combustible Gases - only for Sat-Ex C-Versions				
CH4 Methane	9602-9902	0 ... 100	% LEL	wide-range sensor for combustible gases

8.2 4-20 mA Signal Output Range (page 1 of 2)

Substance / Sensor		Part No. Sensor	4 - 20 mA Range					Alarm 1 Setting
				Min	Default	Max	Unit	
8.2.1 Toxic and Corrosive Gases - not for Sat-Ex C-Versions								
AsH3	Arsine (3 El.)	9602-6004	0 ...	0.15	1.00	10.00	ppm	0.05
AsH3	Arsine (2 El.)	9602-6000	0 ...	0.15	1.00	10.00	ppm	0.05
AsH3	Arsine (2 El.)	9602-6002	0 ...	3.0	10.0	10.0	ppm	1.0
B2H6	Diborane	9602-6202	0 ...	0.30	1.00	10.00	ppm	0.10
Br2	Bromine	9602-6800	0 ...	0.30	5.00	10.00	ppm	0.10
Cl2	Chlorine	9602-5300	0 ...	1.50	5.00	10.00	ppm	0.50
ClF3	Chlorine Trifluoride	9602-7410	0 ...	0.30	1.00	5.00	ppm	0.10
ClO2	Chlorine Dioxide	9602-7400	0 ...	0.30	1.00	5.00	ppm	0.10
CO	Carbon Monoxide	9602-5400	0 ...	75	500	1000	ppm	30
COCl2	Phosgene	9602-6600	0 ...	0.30	1.00	10.00	ppm	0.10
C2H4O	Ethylene Oxide	9602-8000	0 ...	10.0	20.0	50.0	ppm	3.0
F2	Fluorine	9602-6400	0 ...	0.30	5.00	10.00	ppm	0.10
F2	Fluorine	9602-6401	0 ...	9	30	50	ppm	3
GeH4	Germane	9602-6902	0 ...	0.6	5.0	10.0	ppm	0.2
H2	Hydrogen (1 %)	9602-5100	0 ...	0.300	1.000	1.000	% vol.	0.100
H2	Hydrogen (4 %)	9602-5101	0 ...	3.00	4.00	10.00	% vol.	1.00
H2S	Hydrogen Sulfide	9602-5200	0 ...	30	100	500	ppm	10
H2S	Hydrogen Sulfide (org.)	9602-5201	0 ...	30.0	30.0	50.0	ppm	10.0
H2Se	Hydrogen Selenide	9602-5601	0 ...	0.15	1.00	10.00	ppm	0.05
HBr	Hydrogen Bromide	9602-7000	0 ...	6.0	30.0	50.0	ppm	2.0
HCl	Hydrogen Chloride	9602-5800	0 ...	15.0	30.0	50.0	ppm	5.0
HCl	Hydrogen Chloride	9602-5802	0 ...	15.0	15.0	30.0	ppm	5.0
HCN	Hydrogen Cyanide	9602-5700	0 ...	15.0	30.0	50.0	ppm	10.0
HF	Hydrogen Fluoride	9602-6500	0 ...	9.0	10.0	50.0	ppm	3.0
HMDS	Hexamethyldisilazane	9602-6711	0 ...	0.300	0.500	1.000	% vol.	0.100
HMDS	Hexamethyldisilazane	9602-6712	0 ...	300	500	1000	ppm	100
N2H4	Hydrazine	9602-7600	0 ...	0.30	1.00	10.00	ppm	0.10
NH3	Ammonia (1000 ppm)	9602-6705	0 ...	300	1000	1000	ppm	100
NH3	Ammonia (100 ppm)	9602-6704	0 ...	60	100	200	ppm	20
NO	Nitric Oxide	9602-7200	0 ...	75	250	1000	ppm	25
NO2	Nitrogen Dioxide	9602-7300	0 ...	9.0	25.0	100.0	ppm	5.0
O3	Ozone	9602-7100	0 ...	0.30	1.00	10.00	ppm	0.10
O3	Ozone	9602-7101	0 ...	0.30	1.00	10.00	ppm	0.10
PH3	Phosphine (3 El.)	9602-6102	0 ...	0.30	1.00	10.00	ppm	0.10
PH3	Phosphine (2 El.)	9602-6100	0 ...	0.30	1.00	10.00	ppm	0.10
SiH4	Silane	9602-6301	0 ...	15.0	50.0	100.0	ppm	5.0
SO2	Sulfur Dioxide	9602-5900	0 ...	6.0	25.0	100.0	ppm	2.0
TEOS	Tetraethyl Orthosilicate	9602-7500	0 ...	30	100	500	ppm	10
TMB	Trimethylborate	9602-7510	0 ...	300	500	1000	ppm	100
TMP	Trimethyl phosphite	9602-7800	0 ...	6.0	30.0	50.0	ppm	2.0

8.2 4-20 mA Signal Output Range (page 2 of 2)

Substance / Sensor		Part No. Sensor	4 - 20 mA Range					Alarm 1 Setting
				Min	Default	Max	Unit	
8.2.2 Oxygen - not for Sat-Ex C-Versions								
O2	Oxygen	9602-5500	0 ...	25.0	25.0	30.0	% vol.	18.0

Substance / Sensor		Part No. Sensor	4 - 20 mA Range					Alarm 1 Setting
				Min	Default	Max	Unit	
8.2.3 Combustible Gases - only for Sat-Ex C-Versions								
CH4	Methane - (wide-range sensor for combustible gases)	9602-9902	0 ...	60	100	100	% LEL	20

Min	minimum settable range	Note:
Default	nominal (standard) range	Alarm 2 Setting = 2 x Alarm 1 Setting
Max	maximum settable range	Default and Alarm Settings are the standard values set ex factory.

8.3 K-Factors for Sat-Ex C-Versions

Catalytic sensors are calibrated for methane. When monitoring for other combustible gases, a specific correction factor must be entered; consult our local representative.

8.4 Spares and Accessories

Part Number	Description
20202-4000	bar magnet, to operate Sat-Ex controls
20202.0090	sensor extension standard, 2 m
20202.0091	sensor extension standard, 3 m
20202.0092	sensor extension standard, 1 m
20202.0093	sensor extension combustible, 2 m (for Sat-Ex C-versions)
20202.0094	sensor extension combustible, 3 m (for Sat-Ex C-versions)
20202.0095	sensor extension combustible, 1 m (for Sat-Ex C-versions)
20230-0100	junction box, protection class "Ex e", 2 nodes
20230-0105	junction box, protection class "Ex e", 1 node, relay version
9602.0095	calibration cap
9902-4000	duct mounting saddle (assy), 4 inches
9902-4010	duct mounting saddle (assy), 6 inches
9902-4020	duct mounting saddle (assy), 8 inches
9902-4030	duct mounting saddle (assy), 10 inches
9902-4040	duct mounting saddle (assy), 12 inches
9902-4100	duct mounting saddle (assy), 1,5 inches
9902-4110	duct mounting saddle (assy), 2 inches
9902-4120	duct mounting saddle (assy), 2,5 inches
9902-4130	duct mounting saddle (assy), 3 inches
9902-4200	duct mounting saddle (assy), flat

8.5 EC-Type Examination Certificate



Translation

- (1) **EC-Type Examination Certificate**
- (2) **- Directive 94/9/EC -**
Equipment and protective systems intended for use
in potentially explosive atmospheres
- (3) **BVS 04 ATEX E 101 X**
- (4) **Equipment:** Gas monitoring instrument Sat-Ex type 20202-*
- (5) **Manufacturer:** MST Technology GmbH
- (6) **Address:** D 82069 Hohenschäftlarn
- (7) The design and construction of this equipment and any acceptable variation thereto are specified in the schedule to this type examination certificate.
- (8) The certification body of EXAM BBG Prüf- und Zertifizier GmbH, notified body no. 0158 in accordance with Article 9 of the Directive 94/9/EC of the European Parliament and the Council of 23 March 1994, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres, given in Annex II to the Directive.
The examination and test results are recorded in the test and assessment report BVS PP 04.2078 EG.
- (9) The Essential Health and Safety Requirements are assured by compliance with:
EN 50014:1997+A1-A2 General requirements
EN 50018:2000 +A1 Flameproof enclosure 'd'
EN 50020:2002 Intrinsic Safety 'i'
- (10) If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the schedule to this certificate.
- (11) This EC-Type Examination Certificate relates only to the design, examination and tests of the specified equipment in accordance to Directive 94/9/EC.
Further requirements of the Directive apply to the manufacturing process and supply of this equipment. These are not covered by this certificate
- (12) The marking of the equipment shall include the following:

 II 2G EEx d [ib] IIC T4

EXAM BBG Prüf- und Zertifizier GmbH

Bochum, dated 10. May 2004

Signed: Dr. Jockers

Signed: Dr. Eickhoff

Certification body

Special services unit

Page 1 of 3 to BVS 04 ATEX E 101 X
This certificate may only be reproduced in its entirety and without change
Dinnendahlstrasse 9 44809 Bochum Germany Phone +49 201 172-3947 Fax +49 201 172-3948
(until 31.05.2003: Deutsche Montan Technologie GmbH Am Technologiepark 1 45307 Essen)

8.5.1 EC-Type Examination Certificate - 1st Supplement



Translation

1st Supplement

(Supplement in accordance with Directive 94/9/EC Annex III number 6)

to the EC-Type Examination Certificate
BVS 04 ATEX E 101 X

Equipment: Gas monitoring instrument Sat-Ex type 20202-
Manufacturer: MST Technology GmbH
Address: 82069 Hohenschäftlarn, Germany

Description

The instrument can also be manufactured with additional sensor cells.

The Essential Health and Safety Requirements of the modified equipment are assured by compliance with:

EN 50014:1997+A1-A2	General requirements
EN 50018:2000 +A1	Flameproof enclosure 'd'
EN 50020:2002	Intrinsic Safety 'i'

The marking of the equipment shall include the following:

 II 2G EEx d [ib] IIC T4
Special conditions for safe use

The measurement function for explosion protection is not the subject of this EC-Type Examination Certificate.

Test and assessment report

BVS PP 04.2078 EG, as of 24.05.2006

EXAM BBG Prüf- und Zertifizier GmbH

Bochum, dated 24. May 2006

Signed: Dr. Jöckers

Certification body

Signed: Dr. Eickhoff

Special services unit

We confirm the correctness of the translation from the German original.
In the case of arbitration only the German wording shall be valid and binding.

44809 Bochum, 24. May 2006
BVS-Ad/Kw A 20060080

EXAM BBG Prüf- und Zertifizier GmbH

Certification body


Special services unit

Page 1 of 1 is BVS 04 ATEX E 101 X / NI
This certificate may only be reproduced in its entirety and without change.
Dinsendahlstrasse 9 44809 Bochum Germany Phone +49 234/3696-103 Fax +49 234/3696-110

8.5.1 EC-Type Examination Certificate - 2nd Supplement



Translation

2nd Supplement

(Supplement in accordance with Directive 94/9/EC Annex III number 6)

to the EC-Type Examination Certificate BVS 04 ATEX E 101 X

Equipment: Gas monitoring instrument Sat-Ex type 20202-***Manufacturer:** MST Technology GmbH**Address:** 82069 HohenschäftlarnDescription

The unchanged apparatus was assessed and tested against the current standards.

The Essential Health and Safety Requirements of the modified equipment are assured by compliance with:

EN 60079-0:2006 General requirements
 EN 60079-1:2007 Flameproof enclosure 'd'
 EN 60079-11:2007 Intrinsic safety 'i'

The marking of the equipment shall include the following:

II 2G Ex d [ib] IIC T4
Special conditions for safe use

The measurement function for explosion protection is not subject of this test report.

Test and assessment report

BVS PP 04.2078 EG as of 29.04.2009

DEKRA EXAM GmbH

Bochum, dated 29. April 2009

Signed: Simanski

Signed: Dr. Eickhoff

Certification body

Special services unit

We confirm the correctness of the translation from the German original.
 In the case of arbitration only the German wording shall be valid and binding.

44809 Bochum, 29. April 2009

BVS-Ad/Sz A 20090126

DEKRA EXAM GmbH

Certification body

Special services unit

Page 1 of 1 to BVS 04 ATEX E 101 X / N2

This certificate may only be reproduced in its entirety and without change.

DEKRA EXAM GmbH Dürrensdalstrasse 9 44809 Bochum Germany Phone +49 234/3696-103 Fax +49 234/3696-110 E-mail azexam@dekra.com
 (until 31.03.2007 EXAM B9G Prof- und Zertifizier GmbH)

Find out more

www.honeywellanalytics.com

Contact Honeywell Analytics:

Europe, Middle East, Africa, India

Life Safety Distribution AG
Javastrasse 2
8604 Hegnau
Switzerland
Tel: +41 (0)44 943 4300
Fax: +41 (0)44 943 4398
India Tel: +91 124 4752700
gasdetection@honeywell.com

Americas

Honeywell Analytics Inc.
405 Barclay Blvd.
Lincolnshire, IL 60069
USA
Tel: +1 847 955 8200
Toll free: +1 800 538 0363
Fax: +1 847 955 8210
detectgas@honeywell.com

Asia Pacific

Honeywell Analytics Asia Pacific
#701 Kolon Science Valley (1)
43 Digital-Ro 34-Gil, Guro-Gu
Seoul 152-729
Korea
Tel: +82 (0)2 6909 0300
Fax: +82 (0)2 2025 0388
analytics.ap@honeywell.com

Technical Services

EMEA: HAexpert@honeywell.com
US: ha.us.service@honeywell.com
AP: ha.ap.service@honeywell.com

www.honeywell.com

Please Note:

While every effort has been made to ensure accuracy in this publication, no responsibility can be accepted for errors or omissions. Data may change, as well as legislation, and you are strongly advised to obtain copies of the most recently issued regulations, standards, and guidelines. This publication is not intended to form the basis of a contract.

Issue 3 08/2013
H_MAN0886_EMEA
2401M3002_ECO A03534
© 2013 Honeywell Analytics

Honeywell